



This is a digital copy of a book that was preserved for generations on library shelves before it was carefully scanned by Google as part of a project to make the world's books discoverable online.

It has survived long enough for the copyright to expire and the book to enter the public domain. A public domain book is one that was never subject to copyright or whose legal copyright term has expired. Whether a book is in the public domain may vary country to country. Public domain books are our gateways to the past, representing a wealth of history, culture and knowledge that's often difficult to discover.

Marks, notations and other marginalia present in the original volume will appear in this file - a reminder of this book's long journey from the publisher to a library and finally to you.

Usage guidelines

Google is proud to partner with libraries to digitize public domain materials and make them widely accessible. Public domain books belong to the public and we are merely their custodians. Nevertheless, this work is expensive, so in order to keep providing this resource, we have taken steps to prevent abuse by commercial parties, including placing technical restrictions on automated querying.

We also ask that you:


- + *Make non-commercial use of the files* We designed Google Book Search for use by individuals, and we request that you use these files for personal, non-commercial purposes.
- + *Refrain from automated querying* Do not send automated queries of any sort to Google's system: If you are conducting research on machine translation, optical character recognition or other areas where access to a large amount of text is helpful, please contact us. We encourage the use of public domain materials for these purposes and may be able to help.
- + *Maintain attribution* The Google "watermark" you see on each file is essential for informing people about this project and helping them find additional materials through Google Book Search. Please do not remove it.
- + *Keep it legal* Whatever your use, remember that you are responsible for ensuring that what you are doing is legal. Do not assume that just because we believe a book is in the public domain for users in the United States, that the work is also in the public domain for users in other countries. Whether a book is still in copyright varies from country to country, and we can't offer guidance on whether any specific use of any specific book is allowed. Please do not assume that a book's appearance in Google Book Search means it can be used in any manner anywhere in the world. Copyright infringement liability can be quite severe.

About Google Book Search

Google's mission is to organize the world's information and to make it universally accessible and useful. Google Book Search helps readers discover the world's books while helping authors and publishers reach new audiences. You can search through the full text of this book on the web at <http://books.google.com/>

SIMPLE
HYDRAULIC FORMULÆ.


T. W. STONE.

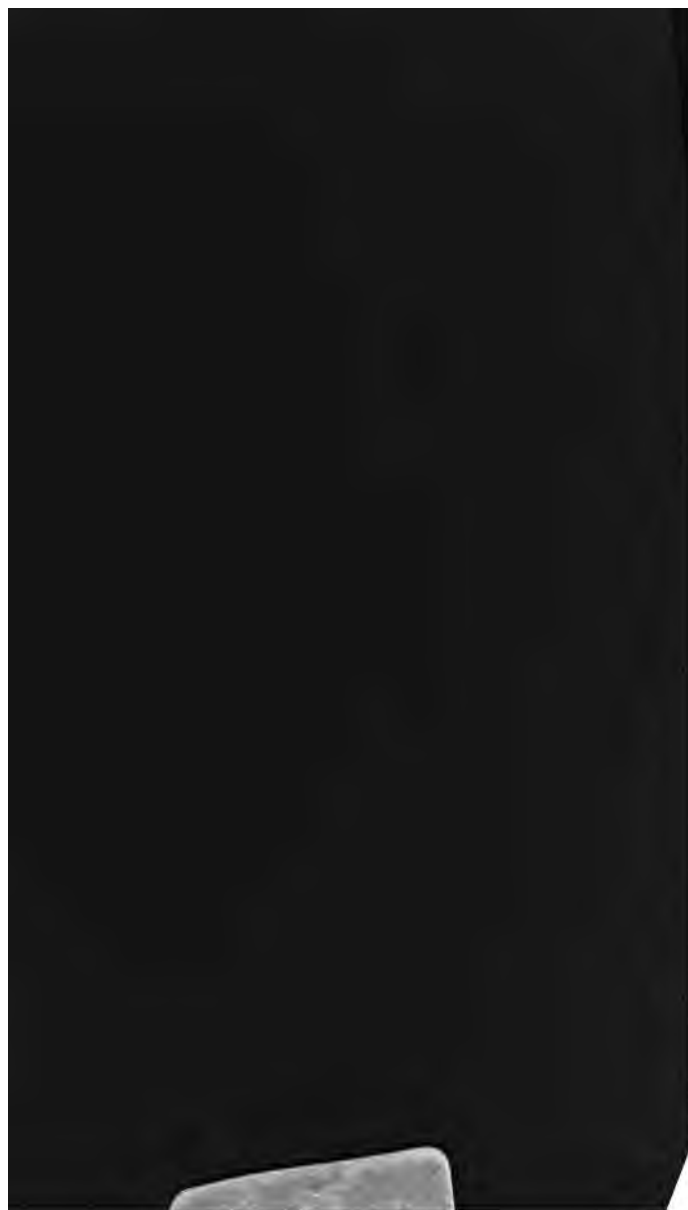





**SIMPLE
HYDRAULIC FORMULÆ.**



SIMPLE HYDRAULIC FORMULÆ.

BY

T. W. STONE,

CIVIL ENGINEER; LATE RESIDENT DISTRICT ENGINEER FOR WATER SUPPLY,
VICTORIA GOVERNMENT, AUSTRALIA.



LONDON

E. & F. N. SPON, 16, CHARING CROSS.

NEW YORK:

446, BROOME STREET.

1881.

186. 9. 180.

INTRODUCTION.

THE author of this work has been led to its publication chiefly through the desire of many professional friends, and he would observe, in offering it to the profession, and others connected with the measurement of water, that it has been his aim not to produce a *treatise* on Hydraulics, for many have been written and leave little or nothing to be desired, but rather to introduce a number of *Hydraulic Formulæ* applicable to almost all cases which may be met with in the actual practice of the Hydraulic Engineer.

Neither does the author lay claim to pure originality; many of the formulæ have been simplified from other authors, and where they have been inserted full proof of their accuracy has been afforded to the author during an extensive practice.

Some of the computations are purely original, notably those for distribution pipes in towns.

The Appendix, No. 1, has been added chiefly for the purpose of enabling miners, and others engaged in sluicing operations or in the use of water for other purposes, to check the quantity of water supplied them, and it is hoped that the general arrangement of the whole work is such as to afford assistance, not only to the professional Hydraulic Engineer, but to those engaged in the use of the water supplied them.

Appendix II. contains numerous worked-out exercises which it is hoped will enhance the value of the work.

T. W. STONE.

October 5th, 1881.



CONTENTS.

CHAPTER I.

| | PAGE |
|--|------|
| ON THE FLOW OF WATER OVER WEIRS.. .. . | 1 |

CHAPTER II.

| | |
|--|----|
| ON THE DISCHARGE OF WATER THROUGH ORIFICES | 14 |
|--|----|

CHAPTER III.

| | |
|--|----|
| ON THE DISCHARGE THROUGH SHORT TUBES | 23 |
|--|----|

CHAPTER IV.

| | |
|---|----|
| ON THE FLOW OF WATER THROUGH LONG PIPES, AND THROUGH DISTRIBUTING PIPES IN TOWNS | 27 |
|---|----|

CHAPTER V.

| | |
|---|----|
| ON THE FLOW OF WATER FROM JETS, AND THE HEIGHTS ATTAINED BY DIFFERENT DIAMETERS OF JET | 52 |
|---|----|

CHAPTER VI.

| | |
|---|----|
| ON THE FLOW OF WATER THROUGH CANALS, RIVERS, AQUE- DUCTS, ETC. | 54 |
|---|----|

APPENDIX I.

| | PAGE |
|---|------|
| SPECIAL FORMULÆ FOR MINERS AND OTHERS ENGAGED IN SLUICING, &c. | 59 |

APPENDIX II.

| | |
|---|----|
| CONTAINING EXAMPLES NOT GIVEN IN THE BODY OF THE WORK | 66 |
|---|----|

APPENDIX III.

| | |
|--|----|
| COEFFICIENTS FOR SHORT LEVEL TROUGHS | 72 |
| TABLES OF COEFFICIENTS, DISCHARGES, ETC. | 73 |

SIMPLE HYDRAULIC FORMULÆ.

CHAPTER I.

PLATE I.

OF THE FLOW OF WATER OVER WEIRS.

THE velocity of a falling liquid without friction is given by the formula

$$V = \sqrt{2gH}, \quad [1]$$

in which V equals the velocity in feet per second, g equals the force of gravity, and H equals the height in feet fallen; the value of g varies slightly in different latitudes, but for the purpose of hydraulic calculations it may be taken as equal to 32.2015, and consequently $2g$ in the following pages is assumed at 64.403.

The height due to a given velocity is expressed by the formula

$$\frac{V^2}{2g} \text{ or } \frac{V^2}{64.403}, \quad [2]$$

the notation remaining the same as for formula [1]. To find, therefore, the theoretical velocity of water flowing over a weir, the formula

$$V = \sqrt{2gH} \quad [3]$$

may be modified to

$$8.025 \times \sqrt{H}. \quad [4]$$

For finding the discharge, however, it is necessary, owing to the contraction of the fluid vein and friction, to reduce the

sectional area of the water to $\frac{2}{3}$ ds of that given by the measurement from the sill of the weir to *still* water, and so multiply by a coefficient determined by experiment according to the conditions under which the weir is placed, the area and width of the approaching channel, the thickness and form of the crest and weir basin. For it is evident if the width of the weir be the same as that of the channel, no contraction will occur at the ends, but if the weir is much narrower than the approaching channel, then contraction occurs, which, according to Francis's experiments, is found to reduce the effective length 0.2 of an inch for each inch depth of overfall. A modification of Francis's rule for weirs with thin plates is

$$G = 2.4953 \times (l - 0.1 n d) \times d^{1.5};$$

where

G = gallons per minute;

d = depth in inches;

n = number of contractions (usually two).

For the actual velocity then the formula [2] will become

$$8.025 \times \sqrt{H} \times c, \quad [5]$$

and for the actual discharge

$$D = 8.025 \times \sqrt{H} \times c \times \frac{2}{3} A; \quad [6]$$

in which

c = the coefficient according to circumstances;

A = the area in square feet;

D = the discharge in cube feet per second;

H = the head in feet.

Tables II. to VI. inclusive show the generally received coefficients for weirs and orifices of different forms. In reference to the experiments of Mr. Blackwell, I have altered the coefficients given in some works by giving their full value. The sectional area of water as taken in these works is incorrect and confusing. It should be only $\frac{2}{3}$ ds of that

area, and the full coefficient of experiment taken. From these tables it would appear that a coefficient of about 0·615 to 0·62 may be taken for notches in thin plates with square edges if the width above the notch is much wider than the width of the notch itself. If the edges are bevelled, as in the diagram, Plate I., the coefficient rises to 0·667, and the discharge can be calculated by the formula

$$\frac{2}{3} \sqrt{d} \times 5 \cdot 34 \times A = D ; \quad [7]$$

in which

d = depth over sill measured to still water, in feet ;

A = area in square feet ;

D = discharge in cube feet per second.

And as this is a formula in ordinary use where gauges fixed according to the diagram are placed across streams for the purpose of comparison with rainfall, I have calculated a Table, No. I., showing the quantities passing over a weir one foot wide for every $\frac{1}{8}$ th of an inch up to 12 inches deep, and then for every $\frac{1}{4}$ th up to 24 inches, which is the highest flow which can be obtained with accuracy from this formula [7], an alteration in the coefficient occurring at greater depths. This table only applies where there is no velocity of approach, and where the form of the weir and approaches are as in the diagram ; in other cases formula [6] must be used and the proper coefficient applied.

OF VELOCITY OF APPROACH.

Where the water approaches the crest of the weir with a sensible velocity, the discharge is that due to the *difference* of discharge between *two* weirs, the one having the discharge calculated from the measured head *plus* the head due to the velocity of approach, and the other calculated from the head due to the velocity of approach only.

Mr. Neville gives a rule and works out an example, page 104, second edition, in which the notch is 7 feet long,

head 8 inches, and velocity of approach $16\frac{1}{4}$ inches per second, and from this, by equation [42], he calculates the discharge as 13.573 cubic feet per second. This rule is, however, complicated, and by the rule I have given the discharge would be as follows, taking .628 as the coefficient:—

$$\begin{array}{rcl} 8.025 \times \sqrt{0.69781} \times 0.628 \times \frac{2}{3} \times 4.88 & \text{Cube feet per second.} & = 13.672 \\ 8.025 \times \sqrt{0.03115} \times 0.628 \times \frac{2}{3} \times 0.21875 & & = 0.129 \end{array} \quad [8]$$

$$\begin{array}{l} \text{Difference which equals discharge in cube feet} \\ \text{per second} \quad \dots \dots \dots \end{array} \left. \vphantom{\begin{array}{l} \text{Difference which equals discharge in cube feet} \\ \text{per second} \end{array}} \right\} 13.543$$

The head due to velocity of approach is found by the formula

$$\frac{\left(\frac{V}{c}\right)^2}{64 \cdot 403} = \text{head in feet} \quad [8A]$$

for an observed velocity of $16\frac{1}{4}$ inches per second = 1.35416
Therefore

$$\frac{\left(\frac{1.35416}{.956}\right)^2}{64 \cdot 403} = 0.03115, \text{ the head in feet required ;}$$

assuming a coefficient of 0.956 for the channel above the weir, which coefficient varies of course according to the description of channel above the weir.

Professor Downing gives a rule where L equals length in feet—

$$D = c \times 5.35 \times L \times \sqrt{H^3 + 0.03494 \times V^2 \times H^2}. \quad [9]$$

The discharge by this formula, taking $c = 0.628$, would be equal to 13.1712 cube feet per second. I consider, however, that [8] is the best and simplest to adopt in practice.

OF THE FLOW OF WATER OVER SUBMERGED WEIRS.

For a submerged weir, or in other words when the *tail water* rises *above* the sill of the weir, the head to be taken becomes the difference of the level of the head and tail waters, then the square root of this head multiplied by the head from the tail water to the sill of the weir, plus $\frac{2}{3}$ of the difference in level between the head and tail waters, equals the discharge in cube feet per second; or by formula,

$$d = 8.025 \times \sqrt{H} \times (D + \frac{2}{3} \times H) \times L \times c; [10]$$

in which

H = difference of level of head and tail waters in feet;

D = " " between tail water and sill of weir
in feet;

c = coefficient according to circumstances;

L = length in feet;

d = discharge in cube feet per second.

When the water approaches the weir with a velocity, the discharge becomes

$$d = 8.025 \times c \times L \times \{D \times \sqrt{H + H'} + \frac{2}{3} (H + H')^{1.5} - H'^{1.5}\} [11]$$

in which H' equals the head in feet due to the velocity of approach taken in feet per second.

The index 1.5 or $\frac{3}{2}$ denotes the cube of the square root of the expressions to which it is attached, and is easily found by multiplying the logarithm of the number to which the index is attached by that index.

For example, what is the value of the expression

$$4^{\frac{3}{2}} \text{ or } 4^{1.5} ?$$

$$\text{Log of } 4 = 0.60206$$

$$1.5$$

$$\hline 301030$$

$$60206$$

$$\hline 0.903090$$

corresponding to number 8;

consequently

$$4^{\frac{2}{3}} \text{ or } 4^{1.5} = 8.$$

Example of Calculation for Submerged Weir.—What is the discharge over a submerged weir (Plate I.) 40 feet long, and with the heads as in diagram, and an observed velocity of approach of 2 feet per second?

First, the head due to velocity of approach is, taking the coefficient of 0.956, to reduce the observed velocity to the theoretical velocity, equal to

$$\frac{\left(\frac{2}{.956}\right)^2}{64 \cdot 403} = 0.067 \text{ feet;}$$

and taking the mean coefficient 0.628, we have for 1 foot of length

$$8.025 \times .628 \times 1 \times \{0.8 \times \sqrt{1.5 + 0.067} + \frac{2}{(1.5 + 0.067)^{1.5}} - 0.067^{1.5}\}$$

for the discharge in cubic feet per second, equal to 11.68 cubic feet per second.

Then $11.68 \times 40 = 467.2$ cube feet per second for 40 feet wide. The coefficients of the submerged depth, D, and the upper part, H, generally differ according to experiments, and it is found that from 0.5 to 0.6 may be taken to represent the coefficient for the submerged depth, D, and 0.67 for the upper part, H. The formula for a submerged weir with these coefficients would become

$$L \times \sqrt{H} \times \{3.56 \times H + 4 \times D\} \quad [12]$$

= discharge in cube feet per second; with no velocity of approach, and all dimensions in feet. Where there is a velocity of approach and the coefficients differ, formula [11] should be used, using the proper coefficients to each portion of the expression.

Formula [10] is used on the supposition that $\frac{2}{3}$ H or $\frac{2}{3}$ rds

of the difference of level in feet between the upper and lower waters, plus D , the depth in feet from the lower water to the sill of the weir together, multiplied by the length in feet, equals the area in square feet to be multiplied by the theoretical velocity, or

$$8.025 \sqrt{H},$$

for the theoretical discharge, which again multiplied by the coefficient of discharge, according to the nature of the case, gives the actual discharge in cube feet per second. And it therefore appears that when the water approaches the weir with a sensible velocity, the discharge over a submerged weir may be taken as the difference of discharge between two weirs, that for the first weir being calculated by formula [10], $H + H'$ being substituted for H , and for the second substituting for H in the formula [10] H' , or the head due to the velocity of approach, and for the expression $(D + \frac{2}{3}H) \times L$, an area equal to $\frac{2}{3}H' \times L$.

Taking the former example given to formula [11], we shall have for 12 inches wide, and taking the coefficient .628 for both depths

$$\begin{aligned} 8.025 \times \sqrt{1.567} \times (.8 + \frac{2}{3} 1.567) \times 1 \times .628 &= 11.62 \\ 8.025 \times \sqrt{0.067} \times \frac{2}{3} (0.067 \times 1) \times .628 &= 0.06 \end{aligned} \quad [11A]$$

$$11.56$$

equal to discharge in cube feet per second for 12 inches wide. Therefore $11.56 \times 40 = 462.4$ cube feet per second for 40 feet wide, or a difference of only 1 per cent. from formula [11] with much less labour. A few more useful formulæ and examples are appended before closing this chapter.

Having given the depth of water over a weir and the length of the same, to find what depth of water will flow over a weir with a different length, the discharge remaining the same, the following formula may be used:—

$$d_1 = \left(\frac{w}{w_1}\right)^{\frac{2}{3}} \times d, \quad [12A]$$

in which w and w_1 equal the lengths of the two weirs, and d and d_1 the different depths passing over.

Example.—Water flowing down a river rises to a height of 0·87 feet on a weir 62 feet long; to what height will the same quantity of water rise on a weir similarly circumstanced 120 feet long?

$$\begin{array}{r} \left(\frac{62}{120}\right)^{\frac{2}{3}} \times 0\cdot87. \\ \text{Log of } \cdot516 = -1\cdot71265 \\ \hline \div 3 = -1\cdot90421 \\ \times 2 = 2 \\ \hline -1\cdot80842 \end{array}$$

Number corresponding to log ·644.

Then $0\cdot644 \times 0\cdot87 = 0\cdot567$ or 6·8 inches = height required.

The fraction $\frac{2}{3}$ represents the square of the cube root of the expression to which it is attached. For example:—

What is the equivalent of $4^{\frac{2}{3}}$?

$$\begin{array}{r} \text{Log of } 4 = 0\cdot60206 \\ \hline \div 3 = 0\cdot20068 \\ \times 2 = 2 \\ \hline 0\cdot40136 \end{array}$$

Number corresponding to log 2·52.

$$\therefore 4^{\frac{2}{3}} = 2\cdot52.$$

It is also useful sometimes to find the horizontal distance to which a cascade from the crest of a weir will leap in the course of a given fall below the crest. It may be calculated by the following rule, supposing a coefficient of 0·667:—

$$v = 8\cdot025 \times \sqrt{H} \times \cdot667, \quad [12B]$$

which may be reduced to

$$v = 5.35 \times \sqrt{H}, \quad [18]$$

H being the height in feet to still water, and v the velocity in feet per second, remembering that to obtain the velocity the proper coefficient to suit the case must always be used.

Then to find the distance leaped by the cascade we have—

$$d = \frac{2v \times \sqrt{z}}{8.025} = \frac{4}{8} \cdot \sqrt{z \times H}; \quad [14]$$

in which

z = the given fall in feet;

d = the horizontal distance in feet;

H = the head to still water over the weir sill in feet;

v = the velocity in feet per second.

Example.—To what horizontal distance will the water leap in falling 10 feet from the sill of a weir over which the head to still water is 6 inches, using the coefficient of .667?

$$\frac{4}{8} \sqrt{10 \times .5} = 2.97 \text{ feet.}$$

To calculate the depth at which the sill of a weir should be placed *below* the original surface to ensure a given depth d_1 over the original surface, the weir being submerged, the following formula may be used:—

$$d_2 = \frac{D}{c \times l \times 8.025 \times \sqrt{d_1}} - \frac{2}{3} d_1; \quad [17]$$

in which

c = the coefficient of discharge;

D = the discharge in cube feet per second;

l = the length of the weir in feet;

the other symbols as stated above.

Or by taking the velocity of approach, if any, into account,

$$d_2 = \frac{D}{c \times l \times 8.025 \times \sqrt{d_1 + h}} - \frac{\frac{2}{3} (d_1 + h)^{1.5} - h^{1.5}}{\sqrt{d_1 + h}} \quad [18]$$

in which

h = the head due to velocity of approach.

Example.—For a river discharging 812.5 cubic feet per second, and 70 feet wide at surface, to what depth d_2 shall the sill of a weir be placed below the original surface to ensure the depth of water immediately above it being increased by 18 inches or 1.5 feet? We have then, taking .628 as the coefficient of discharge, and as the weir is 70 feet wide, 11.6 feet per second will pass over each foot,

$$\begin{aligned} d_2 &= \frac{11.6}{.628 \times 1 \times 8.025 \times \sqrt{1.5}} - \frac{2}{3} \times 1.5 \\ &= 1.88 - 1 = 0.88 = \text{height in feet required;} \end{aligned}$$

the submerged weir must therefore be built 0.88 feet *below* the surface to raise the head 1.5 feet above the former level.

Taking the velocity of approach into account, the result becomes by formula [18], taking the value of h calculated from formula [2], and taking the theoretical velocity as equal to 2 feet per second $\frac{2^2}{64.403} = 0.062$ feet head. Then for 1 foot in length we have

$$\begin{aligned} d_2 &= \frac{11.6}{.628 \times 1 \times 8.025 \times \sqrt{1.5 + 0.062}} - \frac{\frac{2}{3} (1.5 + 0.062)^{1.5} - 0.062^{1.5}}{\sqrt{1.5 + 0.062}} \\ \therefore d_2 &= \frac{1.84}{- \frac{2}{3} \frac{(1.5 + 0.062)^{1.5} - 0.062^{1.5}}{\sqrt{1.5 + 0.062}}} \end{aligned}$$

The latter part of this expression is best done by logarithms.

| | |
|------------------------|-------------------------|
| Log of 1.562 = 0.19368 | Log of 0.062 = -2.79239 |
| × 1.5 | 1.5 |
| <hr/> | <hr/> |
| 96840 | 796195 |
| 19368 | 279239 |
| <hr/> | <hr/> |
| 0.290520 | -2.188585 |
| Natural number 1.95 | Natural number 0.015 |
| Log of 1.562 = 0.19368 | |
| ÷ 2 for sq. root | 0.09684 |
| Natural number | 1.25. |

Then the expression becomes

$$1.84 - \frac{1.95 - 0.015}{1.25},$$

or

$$1.84 - 1.03,$$

or

$$d_2 \text{ is equal to } 0.81 \text{ feet.}$$

The following formulæ give the discharge in cubic feet per second through notches of the various forms shown in the diagrams, Plate I.

For

$$A, D = \frac{2}{15} \times c \times 8.025 \times d^{1.5} \times (2 \times t + 3b) \quad [20]$$

$$B, D = \frac{2}{3} \times c \times l \times d^{1.5} \times 8.025 \quad [21]$$

$$C, D = \frac{2}{15} \times c \times 8.025 \times d^{1.5} \times \{(2 \times t) + (3 \times b)\} \quad [22]$$

$$D, D = c \times 8.025 \times \frac{4}{15} \times t \times d^{1.5}; \quad [23]$$

which for a right-angled triangle becomes

$$D = c \times 8.025 \times \frac{8}{15} \times d^{2.5}; \quad [24]$$

for

$$E, D = c \times 8.025 \times 0.9752 \times l \times d^{1.5}; \quad [25]$$

and when the parallelogram becomes a square,

$$D = c \times 8.025 \times \sqrt{l} \times 0.34478 \times l^2. \quad [26]$$

For

$$F, D = c \times 8.025 \times \frac{a}{15} \times b \times d^{1.5} \quad [27]$$

$$G, D = c \times 8.025 \times \sqrt{r} \times 0.6103 \times A \quad [28]$$

$$H, D = c \times 8.025 \times \sqrt{r} \times 0.9604 \times A \quad [29]$$

$$I, D = c \times 8.025 \times \sqrt{r} \times 0.7324 \times A \quad [30]$$

where

D is equal to discharge in cube feet per second ;

c a coefficient according to circumstances (see Diagram) ;

d the depth in feet.

t width at top or surface of water in feet ;

b „ bottom in feet ;

r the radius in feet ;

l the length in feet.

One example will suffice.

What is the discharge from a triangular notch, the width of water or t being equal to 2 feet and the depth or d equal to 1.73 feet, and taking a coefficient of 0.617 by [23] we have

$$.617 \times 8.025 \times \frac{4}{15} \times 2 \times 1.73^{1.5} = 5.993.$$

| | | | | | |
|--------------------------|---|----------|-------------|---|----------|
| Log of 0.617 | = | -1.79029 | Log of 1.73 | = | 0.23805 |
| „ 8.025 | = | 0.90444 | | | 1.5 |
| „ .266 or $\frac{4}{15}$ | = | -1.42488 | | | |
| „ 2 | = | 0.30103 | | | 119025 |
| „ 1.73 ^{1.5} | = | 0.35707 | | | 23805 |
| | | <hr/> | | | <hr/> |
| | | 0.77771 | | | 0.357075 |
| No. of log | | 5.993 | | | |

Therefore the discharge is equal to 5.993 cubic feet per second. It may be well to mention that the formula given by Professor Thompson for a right-angled triangle for discharges of from 2 to 10 feet per minute is as follows :—

$$Q = 0.317 \times H^{2.5},$$

in which

Q is equal to the quantity in cube feet per minute,

H „ „ head in inches,

and it appears that a coefficient of 0·617 used in the formula [24] of this work will give the same result as that obtained by the Professor in his formula. The advantage claimed for a triangular notch is that the coefficient probably remains the same for different depths and widths.

The diagrams in illustration of this chapter are given in Plate L, with the coefficients and formula I propose for each form.

CHAPTER II.

PLATE II.

ON THE DISCHARGE OF WATER THROUGH ORIFICES.

ALTHOUGH the velocity due to the height of water above the centre of gravity of an orifice is not strictly the mean velocity, still for all practical purposes it may be so taken, and the coefficients of discharge given in the tables comprehend the correction for the error arising from using the head from still water to the centre of gravity of the orifice, and this correction becomes inappreciable when the head exceeds three times the height of the orifice.

This *Theoretical* velocity is found to be equal to the expression

$$V = 8.025 \times \sqrt{H},$$

and the *Theoretical* discharge equal to

$$D = 8.025 \times \sqrt{H} \times A;$$

in which

V = theoretical velocity;

H = { head of water over the centre of gravity of the
orifice measured to still water in feet;

D = theoretical discharge in cube feet per second;

A = area of the orifice in square feet.

Before entering into coefficients which should be used for obtaining the *actual* discharge in different cases, it may be well to give the general rules for finding the centre of gravity of the different shaped orifices which may possibly be met with in practice.

These are the square, the right-angled parallelogram, the

trapezoid, the triangle, the circle, the semicircle, and the polygon.

To find the Centre of Gravity of a Trapezoid (see Plate II.).

Let

$$a = AL = LD$$

$$b = BK = KC$$

$$3c = KL;$$

then

$$KG = c \times \frac{b + 2a}{b + a}.$$

Supposing G in the figure, Plate II., to represent the centre of gravity of which it is desired to find the position. For a triangle the centre of gravity lies upon the straight line which joins the summit to the middle of the base at one-third ($\frac{1}{3}$) of this line distance from the base; this line is easily calculated when the sides of the triangle are known, for in the diagram, Plate II., calling the side AB, a ; the side AC, b ; half the side BC or BD, c ; and AD, d ; we have $a^2 + b^2 = 2c^2 + 2d^2$.

Example.—Suppose we have a triangle each side of which is equal to 12" or 1 foot, we have then $1^2 + 1^2 = 2$, and half the base is equal to 0.5, then $0.5^2 \times 2 = 0.5$;

$$\therefore 2 - 0.5 = 1.5$$

equals twice the square of the line AD on the diagram;

$$\therefore \sqrt{0.75} = 0.86.$$

Therefore 0.86 is equal to the length of the line AD, and the centre of gravity is distanced $\frac{0.86}{3}$ or 0.287 feet from the centre of the base.

The centre of a circle is the centre of gravity.

The position of the centre of gravity in a semicircle is equal to

$$0.4244 \times R, \quad [34]$$

where R is equal to the radius.

The centre of gravity in a regular polygon is at its geometrical centre.

It is also necessary in using the formula given to be able to find the areas of the figures enumerated easily, and though these of course may be obtained from any work on mensuration, it will render this work more complete for reference if the modes of finding the areas of the forms of orifice just given are inserted.

For the square. Square its side.

For the right-angled parallelogram. Multiply one side, the larger, by the less.

The trapezoid. Multiply the sum of the parallel sides by the perpendicular distance between them, and half the product is the area.

The triangle. Multiply the base by the perpendicular, and half the product is the area.

The circle. Square the diameter and multiply by 0.7854, and the product will be the area.

The semicircle equals half the area obtained for the full circle.

The segment of a circle less or greater than a semicircle.

Find the area of the sector that has the same arc as the segment; find also the area of the triangle whose vertex is the centre and whose base is the chord of the segment, then the area of the segment is the difference, or sum of these two areas, according as the segment is greater or less than a semicircle.*

The regular polygon. First find the interior angle by the following rule. From double the number of sides of the polygon subtract 4, multiply the remainder by 90, divide the product by the number of sides, and the quotient is the number of degrees in the interior angle; next find the apothegm thus. Multiply half the side of the polygon by

* To find the area of a sector of a circle, multiply the length of the arc of the sector by the radius, and half the product will be the area.

the tangent of half its interior angle, and the product is the apothegm.

Then for the area the following rule may be used. Find the continued product of the side, the number of sides, and the apothegm, and half the product is the area.

To find the area of an irregular polygon. Divide the polygon by means of diagonals into triangles and trapezoids, and find the area of the different figures and add them together for the total area.

When water issues from a circular orifice in a thin plate a contraction occurs at about the distance of half the diameter of the orifice; the diameter of this contraction is equal to 0.784, that of the orifice being 1, and the curve joining these two diameters may be taken as having a radius of about 1.22 times the diameter of the orifice, the velocity at the orifice itself is therefore less than the velocity at the contracted portion in the ratio of 1^2 to 0.784^2 , or 1 to 0.615, and the actual velocity if the area be taken at the opening will become

$$8.025 \times \sqrt{H} \times 0.615. \quad [35]$$

It has been proved from experiment, however, that this coefficient of 0.615 varies with the form of the orifice, the amount of head over it, its position in the sides of the vessel, and the proportion its breadth or diameter bears to the head of water upon it (see Tables II., &c.). The formula then becomes

$$D = 8.025 \times \sqrt{H} \times C \times A; \quad [36]$$

in which

D = discharge in cube feet per second;

H = head in feet from still water to centre of gravity of orifice;

C = a coefficient according to circumstances (see Plate II.);

A = area of orifice in square feet.

SUBMERGED ORIFICES.

When the water from the orifice discharges into air, the head may be assumed as that from the centre of gravity of the orifice to the level of still water above the same, as before stated; but nothing could be more erroneous than to take this head when the orifice is either *wholly* or *partially* submerged. The head or depth in the first case becomes equal to the difference of the pressures, or the difference in height between the surfaces of the water on each side of the orifice. The discharge for a wholly submerged orifice is therefore

$$8.025 \times \sqrt{H'} \times c \times A; \quad [37]$$

in which H' equals the difference of level from still water between the upper and lower waters (see Diagram 2, Plate II.).

When the orifice is partially submerged, the submerged depth is equal to the *difference* in level between the height from the bottom of the orifice to the surface of the upper water, *and* the height from the surface of the upper water to the surface of the lower water, and the remaining depth to the *difference* between the height of the upper water above the lower, *and* the height from the top of the orifice to the upper water, or in the Diagram 3, Plate II.

The submerged depth equal to $b - h$

And the remaining depth equal to $h - t$.

Calling, then, the submerged depth d and the remaining portion d_1 , and h the difference of level of the still water on each side of the orifice, we have for the discharge of the submerged portion in cubic feet per second, with all dimensions in feet, equal to

$$c \times l \times d \sqrt{h} \times 8.025, \quad [38]$$

and for the remaining portion d_1

$$\frac{2}{3} \times c \times 8.025 \times (h^{1.5} - t^{1.5}) \times l; \quad [38A]$$

in which

c = the coefficient ;

l = the length in feet ;

and the other letters signify as stated above.

The discharges found by formulæ [38] and [38A] must then be added to obtain the total discharge in cubic feet per second.

This form of the equations is given as the coefficient c may be of a different value for the upper and lower depths. If, however, it is assumed the same, the following equation may be substituted for discharge in cubic feet per second, all dimensions in feet, and the letters having the same value as above.

$$D = c \times l \times 8.025 \times \{d \times \sqrt{h} + \frac{2}{3} \times (h^{1.5} - t^{1.5})\}. \quad [39]$$

ON VELOCITY OF APPROACH.

When the water approaches a *fully* submerged or *unsubmerged* orifice with a sensible velocity, the following formula must be used :—

$$D = A \times 8.025 \times \sqrt{H} \times c \times \sqrt{\left(1 + \frac{H_1}{H}\right)}, \quad [39A]$$

where

D = discharge in cubic feet per second ;

A = area in square feet of the orifice ;

H = head measured from centre of orifice to still water if not submerged, or difference of level between head and tail waters if submerged, in feet ;

c = coefficient according to circumstances (see Plate II.) ;

H_1 = the head in feet due to the velocity of approach (see [8A]).

When a velocity of approach occurs in *partially* submerged orifices, substitute in the formula [39]

$$h + H_1 \text{ for } h,$$

and

$$t + H_1 \text{ for } t.$$

It is frequently required in connection with lock chambers on canals and rivers to find the time that the water takes to rise a certain height in the lock chamber when supplied from the canal, and also to ascertain the time in which the water will fall to a certain level in the chamber when it is required to empty the lock.

In the Diagram 4, Plate II., let it be required to know in what time the surface water K B will sink a given depth to L M; it is given by the formula

$$T = \frac{A}{4.012 \times a} \times \frac{(\sqrt{H+F} - \sqrt{H})}{c}; \quad [40].$$

in which

c = the coefficient;

T = the time in seconds;

A = the *horizontal* area of the vessel in square feet;

a = the area of the orifice O P in square feet;

F and H heights as shown in the diagram feet.

Example.—For a circular tank of 3 feet diameter, in what time will the water fall from K B to L M, or a height F equal to 5 feet, the total depth $H + F$ being equal to 7 feet? The orifice O P being 1 foot diameter and taking .628 as the coefficient, by formula

$$\frac{3^2 \times .7854}{4.012 \times 1^2 \times .7854} \times \frac{(\sqrt{5+2} - \sqrt{2})}{0.628} \overset{\text{Time in}}{\text{secs.}} = 6.42 \quad [40]$$

For the time the water takes to rise in a lock chamber to the level K L, when filled through an orifice O P from a canal or large chamber whose surface always remains at the same level, the time in seconds of rising from L M to K L is given by the formula

$$\frac{2 \times A \times \sqrt{F}}{c \times a \times 8.025}, \quad [41]$$

and therefore the time of rising from the centre of the orifice to L M equal to—

$$\frac{A}{4 \cdot 015 \times c \times a} \times (\sqrt{H} - \sqrt{F}). \quad [42]$$

Supposing, therefore, the lower vessel to be at first empty, first find the contents in cube feet contained by the vessel below the centre of the orifice O P, and call it C, then the time of filling in seconds to the level of the centre of O P is given by the formula

$$\frac{C}{8 \cdot 025 \times c \times a \times \sqrt{H}}; \quad [43]$$

where

H = the head in feet, as shown in the diagram ;

a = area of the orifice in square feet ;

c = a coefficient (see Plate II.).

The time, therefore, of filling up to any level L M is equal to the addition of the time found by [42] and [43] or

$$\frac{C}{8 \cdot 025 \times c \times a \times \sqrt{H}} + \left\{ \frac{A}{4 \cdot 015 \times c \times a} \times (\sqrt{H} - \sqrt{F}) \right\}. \quad [44]$$

These formulæ apply to single locks, but the expressions for double locks are so easily deduced that it is unnecessary to repeat them here. Half the water only is used by providing double locks, but the expense is great, and it depends much upon the available supply of water whether single or double locks should be used ; only half the water is used also by locking boats up and down alternately.

To find the quantity of water expended in passing a boat through a lock, subtract the amount of displacement from the cubic contents of the lock.

ORIFICE UNDER VARIABLE HEAD.

When the head on an orifice is variable, to find the constant head which would have given the same discharge in the same time the following formula may be used :—

$$H' = \left(\frac{H - h}{2(\sqrt{H} - \sqrt{h})} \right)^2;$$

in which

H' = the constant head in feet ;

H = the head of the reservoir at the commencement of the flowing ; and

h = the head in the reservoir at the end of the flowing.

TIME TAKEN TO EMPTY A RESERVOIR UNDER A VARIABLE HEAD.

Take the areas in square feet of the contour line at each foot depth, and convert this into cube feet by multiplying by the depth of one foot, and find the time necessary to discharge this quantity by the formula and coefficient applicable to the discharging orifice ; proceed in the same manner to the last depth, adding the several times together, not forgetting to multiply the last time *obtained* by 2 before adding it. The result of these additions will be the time taken to empty the reservoir.

The closer the contours are taken together, the more accurate will be the result.

CHAPTER III.

PLATE III.

ON THE DISCHARGE THROUGH SHORT TUBES.

WHEN an orifice is thickened or becomes a short tube of a length of about 2 diameters, the discharge is found to increase from that given by an orifice in a thin plate, the contraction in this case being about 0.9 when the diameter of the tube equals 1 and its proportional area 0.9² or .81, but this coefficient also varies as for an orifice in a thin plate (see remarks on causes of variation in coefficients, Chapter II.), and the formula becomes

$$8.025 \times \sqrt{H} \times A \times c = D; \quad [46]$$

in which

H = the head to still water from the centre of gravity of the tube;

A = the area of the tube in square feet;

c = a coefficient according to circumstances (see Plate III.);

D = discharge in cubic feet per second.

It will be seen that the *theoretical* formula for the discharge through a tube is exactly similar to that for a thin plate, but that the coefficient of discharge rises from about 0.615 in a thin plate to about 0.817 in a short tube of 2 diameters.

As the mean coefficient for short tubes with square edges, about 2 to 2½ diameters in length, appears by the tables to be 0.817, I think in practice the formula [46] may be stated, to save labour, as below:—

$$G = \sqrt{H} \times d^2 \times 13; \quad [47]$$

from which we obtain

$$H = \left(\frac{G}{d^2 \times 13} \right)^2, \quad [48]$$

and

$$d = \sqrt{\frac{G}{\sqrt{H} \times 13}}; \quad [49]$$

where

G = gallons per minute;

H = head in feet measured to the *centre* of the lower end of the tube; and

d = diameter in inches.

SUBMERGED TUBES.

When the tube is wholly submerged, then H in the formulæ [46], [47], [48], [49], becomes the difference of level between the upper and lower waters. When the tube is partially submerged, the formulæ [38], [38A], [39] for thin plates may be used, not forgetting to increase the coefficient to 0·817 if the tube have square edges, and to 0·976 if the edges are rounded.

VELOCITY OF APPROACH.

Where the water approaches the tube with a sensible velocity, the formulæ [39], [39A] may be used, substituting in formula [39]

$$h + H_1 \text{ for } h$$

and

$$t + H_1 \text{ for } t$$

(in which the letters have the same signification as in the article on thin plates), for partially submerged tubes, and increasing the coefficient to ·817 for square edges and 0·976 for rounded ones, or by formula.

For *partially* submerged tubes—

$$D = c \times l \times 8 \cdot 025 \times \{d \times \sqrt{h + H_1} + \frac{2}{3} \times (h + H_1)^{1 \cdot 5} - (t + H_1)^{1 \cdot 5}\},^* \quad (49A)$$

* When the coefficient varies for the upper and lower depths in a *partially* submerged tube, use formulæ [38], [38A], substituting

$h + H_1$ for h , and $t + H_1$ for t .

and for *wholly* submerged or *unsubmerged* tubes—

$$D = A \times 8.025 \times \sqrt{H} \times c \times \sqrt{\left(1 + \frac{H_1}{H}\right)}, \quad (49B)$$

the letters having the same signification as in formula [39A] Chapter II., and the coefficient c being taken as 0.817 for tubes with square edges, and .976 with rounded edges. The coefficients generally admitted for tubes may be given as follows:—

When the ends next the reservoir are square edged, the coefficient is 0.817, as above.

When the ends next the reservoir are rounded, the coefficient increases up to 0.976.

When the pipe projects into the vessel, and has square edges, the coefficient is reduced to 0.705.

In tubes converging, the coefficient varies from 0.858 at 1° to 0.844 at 50° , the sectional area of the smaller end being taken in the formula [46].

For a divergent tube the coefficient increases from 0.858, for an angle of 1° , to about 0.885, and at 50° decreases from .985 to .872, the smaller area of the tube being used in both cases.

The discharge may even be increased over the theoretical discharge by a tube of the following dimensions (see Plate III.).

The coefficient in this case appears from Venturi's experiments to rise to 1.57, the area being taken at the narrowest portion.

Where converging, diverging, or the last-named tubes, are *unsubmerged*, *partially* submerged, or *wholly* submerged, the same theoretical formulæ are used as though the tube were of equal bore throughout, the coefficient only being altered to suit the case, and in converging and diverging tubes the area in square feet being taken at the narrowest portion; and it is of the greatest importance in determining the coefficient to be used, to observe accurately the *form* of the entrance to the orifice or tube and its approaches, when it is required to obtain the true from the theoretical discharge.

When a short tube is inclined obliquely (see Diagram 6, Plate III.) the coefficients of discharge decrease and vary at from 0·806 at 5° to 0·710 at 65° with the *horizontal*.

It must be borne in mind that in all short tubes, unless the tube be at least once and a half to twice the diameter, the coefficient will not be increased beyond that due to an orifice in a thin plate, the reason being that the contracted vein at less lengths does not fill the diameter of the pipe. If the tube is longer than about $2\frac{1}{2}$ to 3 diameters, an extra loss occurs also from friction on the sides; this will be dealt with when we come to deal with *long* pipes under pressure.

CHAPTER IV.

PLATES IV. AND V.

ON THE FLOW OF WATER THROUGH LONG PIPES, AND
THROUGH DISTRIBUTING PIPES IN TOWNS.

WHEN water flows through a series of pipes, three things require consideration : the head due to the velocity of entry, the head due to friction, and the head due to change of direction by bends ; in long pipes, that is, pipes over 2000 diameters, the head due to velocity of entry may be neglected, for it bears such a slight proportion to the frictional head that it is of no practical importance, but in short pipes up to 2000 diameters it should never be neglected. The friction between the water and the sides of a pipe of the length l and diameter d is given by the formula

$$\frac{f \times l}{\frac{1}{4} \times D}; \quad [50]$$

in which $\frac{1}{4}D$ equals the "hydraulic mean depth" or "hydraulic radius," which, in circular pipes, always equals one-fourth of the diameter, and f a coefficient, the value of which is given by Darcy as equal to

$$0.005 \left(1 + \frac{1}{48 \times \frac{1}{4}d} \right), \quad [51]$$

where $\frac{1}{4}d$ is given in feet.

It is usual, however, in practice, to use a formula in which this friction is taken into account, and I have always used the following, deduced from Eytelwein, which are easily worked by logarithms, and give very accurate results, except with very low velocities, when a different formula should be used, which will be given hereafter :—

$$G = \sqrt{\frac{(3d)^5 \times H}{L}} \quad [52]$$

$$H = \frac{G^2 \times L}{(3d)^5} \quad [53]$$

$$d = \sqrt[5]{\left(\frac{G^2 \times L}{H}\right)} \div 3 \quad [54]$$

$$L = \frac{(3d)^5 \times H}{G^2}; \quad [55]$$

in which

G = gallons per minute;

H = head in feet;

d = diameter in inches;

L = length in yards.

These formulæ, which are suitable for a velocity of 2 to 3 feet per second, do *not* include the head due to the velocity of entry or bends, which in *all* cases of short pipes must be added to that necessary to overcome friction, as found by formulæ [52] to [55] inclusive, for obtaining the total head required for passing a given quantity of water.

The head due to the velocity of entry may be found by the formula [48], supposing that the orifice is of the form requiring a coefficient of 0·817, otherwise the formula [46] *reversed* must be used, applying the right coefficient.

Example.—What is the head required to force 100 gallons per minute through a 4-inch pipe 100 yards long?

| | |
|--------------------------------|---|
| | Head required, feet. |
| For velocity of entry .. | $\left(\frac{100}{4^2 \times 13}\right)^2 = 0\cdot23$ |
| For friction | $\frac{100^2 \times 100}{(3 \times 4)^5} = 4\cdot01$ |
| Total head required in feet .. | <u>4·24</u> |

The *hydraulic inclination* of this pipe is therefore 4 ft. 0½ in.

To make this clear, the *hydraulic inclination* of a pipe

being often mistaken for its actual fall from end to end, let us refer to Diagram 1, Plate IV.

The two pipes AB and CD of the same length have precisely the same *hydraulic inclination*, supposing the discharging ends B and D to be on the same level, notwithstanding the position of their entrances, A and C, in the vessel, or their actual inclinations.

If they be of the same diameter, and the orifices of entry similar, the velocities are also the same, and therefore the head h , which we will assume as the head due to velocity of entry, is similar; the head, therefore, to be divided by the length for the *hydraulic inclination* of both the pipes AB and CD is the total head H less h , the head required for velocity of entry, or $\frac{h_1}{l}$ is equal to the hydraulic inclinations of the pipes in question.

It is the practice of some engineers to obtain the head h by first obtaining an approximate velocity, and then, by a series of tentative operations, repeating the approximations until accuracy is obtained, but this, it appears to me, is at least a very clumsy way of attaining the desired end. The best plan is to assume any discharge at first, and calculate the heads required for velocity of entry, bends, and friction, and add these heads together; the proper discharge may then be found by the rule that in any pipe or series of pipes the diameter and length being constant the discharge varies directly as the square root of the head.

Example.—What is the discharge through a 6-inch pipe 3000 yards long with a head of 50 feet?

First, assume a discharge of 200 gallons per minute.

| | | Head required in feet. |
|--|--|---------------------------|
| <i>For velocity of entry</i> | $\left(\frac{200}{6^2 \times 13}\right)^2$ | = 0.182 |
| <i>For friction</i> | $\frac{200^2 \times 3000}{(3 \times 6)^5}$ | = 63.500 |
| Total head in feet required per 200 gals. per minute | | 63.682 |

Working by logarithms :

$$\begin{array}{r}
 \text{Log } 200 = 2.30103 \\
 \quad \quad 2.67024 \\
 \hline
 - 1.63079 \\
 \times 2 \quad \quad 2 \\
 \hline
 - 1.26158 \\
 \text{No. of log} = \quad .182
 \end{array}$$

$$\begin{array}{r}
 \text{Log of } 6 = 0.77815 \\
 \quad \times 2 \quad \quad 2 \\
 \hline
 1.55630 \\
 \times 13 \quad 1.11394 \\
 \hline
 2.67024
 \end{array}$$

$$\begin{array}{r}
 \text{Log of } 18 = 1.25527 \\
 \quad \quad 5 \\
 \hline
 6.27635
 \end{array}$$

$$\begin{array}{r}
 \text{Log of } 200 = 2.30103 \\
 \quad \times 2 \quad \quad 2 \\
 \hline
 4.60206 \\
 \times 3000 \quad 3.47712 \\
 \hline
 8.07918 \\
 \text{Log } 18^5 \quad 6.27635 \\
 \hline
 1.80283 \\
 \text{No. to log} \quad 63.5
 \end{array}$$

therefore the true discharge is equal to

$$\frac{\sqrt{50} \times 200}{\sqrt{63.682}} = 157.03.$$

Gallons per
minute.

If bends had occurred in the pipe the head required for them would have been added before performing this last proportion.

For pipes with very low velocity it is best to use Prony's rule, which modified is

$$100 \times \sqrt{H M D \times \frac{L}{H}} - 0.15, \quad [56]$$

equal to velocity in feet per second, in which $H M D$ = the hydraulic radius, or the area divided by the wetted perimeter,

both in feet, and $\frac{L}{H}$ the *hydraulic inclination* of the pipe in feet (see remarks on *hydraulic inclination*).

The rule may be altered to

$$G = \left\{ \sqrt{\left(16 \cdot 353 \times \frac{H \times d}{L} + 0 \cdot 00665 \right)} - 0 \cdot 0816 \right\} \times d^2 \times 2 \cdot 04, \quad [57]$$

and to

$$H = \frac{\left\{ \left(\frac{G}{2 \cdot 04 \times d^2} + 0 \cdot 0816 \right)^2 - 0 \cdot 00665 \right\} \times \frac{L}{d}}{16 \cdot 353}, \quad [58]$$

where the letters have the same signification as in formula [52].

Rules [57] and [58] only give the head required for friction, that for velocity of entry and bends must always be added.

There is yet another loss of head to be treated of, viz. that due to bends, the formulæ for which may be taken as follows:—

$$H = \left\{ 0 \cdot 131 + (1 \cdot 847 \times \left(\frac{r}{R} \right)^{3 \cdot 5}) \right\} \times \frac{V^2 \times \phi}{960}; \quad [58A]$$

and

$$V^2 = \frac{960 \times H}{\phi \times \left\{ 0 \cdot 131 + (1 \cdot 847 \times \left(\frac{r}{R} \right)^{3 \cdot 5}) \right\}}; \quad [58B]$$

in which

H = the head due to change of direction in inches;

r = radius of the bore of the pipe in inches;

R = radius of the centre line of the bend in inches;

ϕ = angle of bend in degrees;

V = velocity of discharge in feet per second.

As before stated with regard to $\frac{3}{2}$, the fraction $\frac{7}{2}$ or $3 \cdot 5$ means the 7th power of the square root of the number to which it is attached, or the logarithm of the number multi-

plied by 3.5 gives the logarithm of the number raised to the 3.5 power.

The preceding formulæ have reference chiefly to circular pipes, but the discharge of rectangular or any form of pipes is easily found by finding the *hydraulic* radius or hydraulic mean depth, equal to the area divided by the wetted perimeter for the form required, and then calculating the discharge of a pipe of the same hydraulic mean depth, which will equal the discharge required. This is founded on the rule that *the velocity of discharge, whatever may be the form of the pipe or channel, is proportional to the hydraulic mean depth.*

Before applying any of these formulæ, however, there are several most important subjects to consider.

A pipe may follow the section of the ground so long as it nowhere rise above its hydraulic mean gradient, or virtual declivity. Thus in Plate IV., Figure 2, the discharge due to the pipe A B, if of equal diameter throughout, is equal to the head H and the length A B, h being the head for velocity of entry.

If, however, the ground rises above this line of virtual declivity, as in Figure 3, Plate IV., the discharge of the pipe C D, if of equal diameter throughout, will only be equal to the head due to the difference of level of G and E, and the length C E, for the lower part of the pipe would only act as a trough, and convey the water due to the head H for friction, and h for velocity of entry.

The pipe from F to D would therefore be valueless for attaching services to, as the pressure would be lost if a full draught prevailed at D.

The proper way would be to use pipes of two diameters, the larger one from C to E, and the smaller one from E to D.

This shows how important it is in laying out compound mains to first calculate the hydraulic gradients, and then lay them on the plotted section of the ground, so as to see that none of the hill-tops rise above them.

When a compound main pipe is given, of which it is required to calculate the gradients, the best plan is to *assume*

any discharge, and calculate the head due to velocity of entry and friction and bends for each pipe on this *assumed* discharge; by this means a total head required for the *assumed* discharge will be obtained, and as the real head will be divided amongst the several pipes in the same proportion, the actual gradients can easily be calculated and laid on the section.

Before entering on the subject of the distribution of the water in the town after the supply has been brought there by the main pipe from the service reservoir, the following important laws with respect to pipes should be well considered. Rules [60], [62], and [63], refer only to long pipes, or pipes of 2000 diameters.

[59] When the *length* and *diameter* are *constant*, the discharge varies directly as the square root of the head. The converse of this is also true, viz. that the head is directly as the square of the discharge.

[60] When the *head* and *length* are *constant*, the discharge is directly as the 2·5 power of the diameter, and conversely the diameter is directly as the 2·5 root of the discharge.

[61] When the *discharge* and *diameter* are *constant*, the head is directly as the length.*

[62] When the *length* and *discharge* are *constant*, the head will be *inversely* as the 5th power of the diameter, and conversely the diameter will be *inversely* as the 5th root of the head.

[63] When the *head* and *diameter* are *constant*, the discharge will be *inversely* as the square root of the length, and conversely the length is *inversely* as the square of the discharge.

[64] If a pipe of *uniform* diameter has a series of branches diverging from it, so that the flow of water through it becomes less and less at an uniform rate until the pipe terminates at a dead end, the virtual declivity goes on diminishing, being proportional to the *square of the distance*

* The 2·5 power, or 5th power of square root, of any number is found by multiplying the logarithm of the number by 2·5, and finding the number corresponding to this resulting log. The 2·5 root, or square of the 5th root, is found by dividing the log. of the number by 2·5.

from the dead end, and the excess of the head at any point above the head at the dead end is proportional to the *cube of the distance from the dead end*, and the total virtual fall from the commencement of the pipe to the dead end is *one third* of what it would have been had the whole quantity of water flowed along the pipe without diverging into branch pipes.

[65] When a horizontal pipe A B (see Plate IV., Figure 4), and a head at A, is that due to a velocity in C D, the discharge from the pipe A B will be equal to that from C D, but a peculiar property belongs to the pipe A B in the position in which it is here placed, for if we cut it short at any point *e*, or lengthen it to any extent to E, the discharge will remain the same, and equal to that through the horizontal pipe C D. The velocity in A B (at the angle of inclination A B C, when A C equals the head for friction, or *f* in the diagram, and A B equals C D) is therefore such that it remains unaffected by the length A E, or A *e*, to which it may be extended or cut short, and at this inclination the water in the pipe A B is said to be “in train,” and hence the utility of fixing a general *hydraulic inclination* for the distribution pipes in a town, to be described hereafter.

We will now proceed, with the aid of these rules, to describe the best mode of proceeding in order to determine the diameters of the distributing pipes in the town, and to do this we will refer to the diagram of a supposititious town water supply, and follow step by step the calculations necessary.

It is proposed to supply a town arranged as in the diagram Plate V. (inclusive of increase) with water. By what sized mains and distributing pipes will the proposed supply be effected, after leaving the service reservoir?

As to Quantity.—It is first necessary to estimate the quantity of water which will be required.*

We will assume that 40 gallons per head per day is this quantity; it of course varies in different localities—in England, from 25 to 30 gallons per head per day being generally

* This, in some cases, has been done to determine the drainage area required to the *storage* reservoir.

ample for all purposes. At this rate (40 gallons), a daily supply of 40×4000 equal to 160,000 gallons would be required in 24 hours.

It would, however, be exceedingly erroneous to calculate the sizes of the distribution mains on this assumption, for it is evident that nearly the whole of the supply for domestic purposes will be drawn off during a limited number of hours. Various estimates have been made of the most rapid draught which occurs, and it is evident that this varies much in different towns.

Mr. Hawksley, one of the best authorities on this subject, assumes that $\frac{1}{4}$ of the whole supply may be drawn off in 1 hour, other authorities have found that $\frac{1}{10}$ of the supply is drawn off in 1 hour, or the whole supply in 10 hours, and due regard must be had to the eventual requirements of a town which is likely to increase, in fixing the rate of most rapid draught. In the case before us we will assume, with Mr. Hawksley, that the whole supply will be drawn off in 4 hours, and therefore, in the case under our consideration, the supply for which the diameters of the mains must be calculated will be equal to $160,000 \times 6 =$ at the rate of 960,000 gallons in 24 hours.

As to Head.—A proper rate of virtual head must be given to the pipes, and as a clear pressure of at least 20 feet over the tops of the houses should be left even during the most rapid flow of water, in order that the upper stories of the houses or places of business may be supplied, and that a sufficient jet may be obtained directly from the main in cases of fire, the general rate of virtual declivity to be fixed for the distributing pipes must depend on the contour levels of the town in question.

While on this subject, I would suggest that where it is proposed to supply a town with water, a plan showing its contour lines should be prepared; this is easily done, if none exists, by obtaining the sections of the streets, and from them laying down fixed levels on the plan—in fact, in all cases of water supply and drainage a plan of this description is invaluable, both for the first calculations of the sizes of the

distribution mains or sewers and for the laying of new mains rendered necessary by the want of increased distribution owing to an increase in population. It is also necessary in large towns to ascertain the proportional distribution of the inhabitants in the town, so as to determine the proportionate quantity of water required in each district. Returning to the example under consideration: It is usual, in the first place, to calculate a main from the *service* reservoir to the centre of the town of sufficient size to deliver the quantity required during the most rapid discharge estimated; this in our case is at the rate of 960,000 gallons in 24 hours, or say 667 gallons per minute. It is proposed to extend the supply to the contour line 110 feet below the *service* reservoir, and as it may be necessary to extend it eventually to the contour 90 feet below same, the available head at this point will be 90 feet, but as the water should issue at this point with a head of 20 feet over the tops of the houses in case of fire, we will assume the available head to be 50 feet, which head may be assumed as the virtual declivity of the pipes, and be taken in computing the size of the main from the *service* reservoir to the centre of the town, by Formula [54]; the pipe being a long one, no notice need be taken of the velocity of entry.

$$\sqrt[5]{\frac{667^2 \times 1452}{50}} \div 3 = \text{Diameter in inches.} \quad 8.80$$

$$\begin{array}{r} \text{Log } 667 = 2.82413 \\ \times 2 \qquad \qquad 2 \\ \hline \qquad \qquad 5.64826 \\ \text{Log } 1452 = 3.16196 \\ \hline \qquad \qquad 8.81022 \\ \text{Log } 50 = 1.69897 \\ \hline \div 5 \qquad 7.11125 \\ \hline \qquad \qquad 1.42225 \end{array}$$

26.4, number corresponding to logarithm,
which divided by 3 is equal to 8.80, or say 9 inches, and
adding 1 inch for possible corrosion, say 10 inches.

Having now determined the diameter of the main from the service reservoir to the centre of the town, and remembering that in some towns the estimate of the full quantity in 4 hours would be too much, 8 or even 10 hours may frequently be taken, we will now fix the sizes of the distribution mains on the same assumption, and allowing 4 feet loss of head for every 220 yards.

In adopting the loss of head equal to 4 feet in every 220 yards, it must be remembered that it is only an assumption, and it is *not* meant in assuming it that the service reservoir should be placed at a height above the town which would allow of this loss of head in all the mains *at one time*, for it is evident that this would in most cases be impossible, and it is also unnecessary, 90 to 150 feet above the highest portion of the town to be supplied being in all cases ample. The reason that it is best to act in *calculating* the sizes of the distribution pipes on the *assumption* that a loss of head of 4 feet in every 220 yards occurs, and that the whole of the water taken off from each length has to be passed to the end of that length, is that in some few mains this loss may occur, and they must be proportioned to the greatest hourly demand, even though this demand and consequent loss of head only occurred in one length of 220 yards for one second of time.

It will be evident that with the town under consideration, if an *actual loss of head of 4 feet in every 220 yards of main in the town occurred at one second of time*, and an allowance be made for discharge under a clear head of 20 feet over the tops of the houses in the highest portions, the houses being assumed 20 feet high, that the service reservoir should be 260 feet above the highest portions of the town it is only placed 90 feet above, which is of course ample, as hereafter shown, for the whole of the services could not be drawing at the *assumed* rate at one time. In the following calculations, therefore, it is only *assumed* in calculating the diameters of the different mains that a loss of head of 4 feet in every 220 yards will occur, the actual capability of the reticulation pipes with the service reservoir, at the height shown on the diagram, being afterwards determined by Rule [59].

This must be well understood, as errors are frequently made by taking a statement as an actual fact, whereas it is only an assumption for the purposes of calculation and for proportioning *each* pipe to the greatest hourly demand which it may possibly have to meet in a second of time, though of course all the pipes in the town would not be called upon to meet it at one time.

The part etched and marked *a b c d* in the diagram, Plate V., is supposed to contain 2000 inhabitants, and therefore requires, on the assumption before stated, a supply at the rate of

$$2000 \times 40 \times 6 = 480,000 \text{ gallons in 24 hours,}$$

or say,

$$334 \text{ gallons per minute.}$$

The remaining 2000 persons are distributed over the remainder of the town, requiring a supply at the rate of

$$2000 \times 40 \times 6 = 480,000 \text{ gallons in 24 hours,}$$

or say,

$$334 \text{ gallons per minute.}$$

In this town it will be best to first divide the supply amongst 3 principal mains running north and south, afterwards determining the diameters of the branches by Rule [60]; these mains should run up the streets U T, H Q, and K V. The main U T should be capable of supplying all the water required as far as the street G R, viz. 365,710 gallons in 24 hours, or 254 gallons per minute.

The first 220 yards from C to D will therefore require a diameter equal to the supply of 182,855 gallons in 24 hours, or 127 gallons per minute;* and the second 220 yards, 68,570 gallons in 24 hours, or 48 gallons per minute.

The diameters required are therefore as follows, by Rule [54]:—

* In all these cases it is assumed that the whole of the water taken off from each length has to be passed to the *end* of that length.

Diameter in inches.

For first 220 yards $\sqrt[5]{\frac{127^2 \times 220}{4}} \div 3 = 5.16$, say 5 ins.

„ second „ $\sqrt[5]{\frac{48^2 \times 220}{4}} \div 3 = 3.49$, say 4 ins.

And by the diagram, from C to B and B to I will be similar sizes.

We next come to the main to be laid up the street HQ.

This main should be capable of supplying all the water required as far as GR on the one side and JP on the other; for the first 220 yards, WX, a quantity equal to 228,570 gallons in 24 hours, or say 159 gallons per minute, is necessary, and for the next 220 yards, or WH, 68,570 gallons in 24 hours, or 48 gallons per minute, are required, therefore—

Diameter in inches.

For the diameter from X to W $\sqrt[5]{\frac{159^2 \times 220}{4}} \div 3 = 5.64$
say 6 ins.

„ „ W to H $\sqrt[5]{\frac{48^2 \times 220}{4}} \div 3 = 3.49$
say 4 ins.

And by the diagram from X to Y and Y to Q the diameters will also be 6 inches and 4 inches respectively.

We have now to consider the main up the street KV.

For the first 220 yards 68,570 gallons in 24 hours, or 48 gallons per minute, will be required; for the second 220 yards 34,285 gallons in 24 hours, or 24 gallons per minute. The diameters required are therefore as follows, by Rule [54]:—

Diameter in inches.

For first 220 yards $\sqrt[5]{\frac{48^2 \times 220}{4}} \div 3 = 3.49$, say 4 ins.

„ second „ $\sqrt[5]{\frac{24^2 \times 220}{4}} \div 3 = 2.65$, say 3 ins.

The main CM through the centre of the town should also have a practical taper.

For the first 220 yards it will be 10 inches, discharging

the full quantity of 667 gallons per minute, that is up to the street FS.

$$\begin{array}{l}
 \text{Between F S and G R } \sqrt[5]{\frac{572^2 \times 220}{4}} \div 3 = 9.4 \\
 \text{„ G R „ H Q } \sqrt[5]{\frac{413^2 \times 220}{4}} \div 3 = 8.27 \\
 \text{„ H Q „ J P } \sqrt[5]{\frac{254^2 \times 220}{4}} \div 3 = 6.8 \\
 \text{„ J P „ K V } \sqrt[5]{\frac{156^2 \times 220}{4}} \div 3 = 5.6
 \end{array}$$

Diameter in inches.

As the head and length used in the above calculations are *constant*, the diameters of the mains in any of the above streets might have been found by Rule [60] for example. What should the diameter of the main from W to X in street H Q be to supply 159 gallons per minute, the diameter of the main from C to D being 5.16 inches, discharging 127 gallons per minute?

Then as

$$\sqrt[2.5]{127} : \sqrt[2.5]{159} :: 5.16 : 5.64,$$

or the same as calculated before, and the practical diameter of the pipe may be taken as 6 inches.

The rule is worked as follows by logarithms:—

$$\text{Log of 159} = 2.20140$$

$$\div 2.5 = 0.88056$$

$$\times 5.16 = 0.71264$$

$$1.59320$$

$$\div \sqrt[2.5]{127} \quad 0.84152$$

$$0.75168$$

Number corresponding to log 5.64.

Having now determined the diameters of the principal mains in the town, it will be necessary to find the diameters of the branch mains, so that services may be attached for the supply of the houses.

For the cross streets in the most thickly populated part we shall require in each 220 yards a quantity of water equal to 71,712 gallons in 24 hours, or 49·8 gallons per minute. The diameters of these cross branch mains may then be determined from any one of the principal mains by Rule [60]; say we determine them from C D.

As

Diameter
of Main.
Inches.

$$\sqrt[2.5]{127} : \sqrt[2.5]{49.8} :: 5.16 : 3.49, \text{ say 4 inches.}$$

By logarithms:—

$$\text{Log of } 49.8 = 1.69723$$

$$\div 2.5 = 0.67889$$

$$\times 5.16 = 0.69897$$

$$\hline 1.37786$$

$$\div \text{log of } \sqrt[2.5]{127} \quad 0.84152$$

$$\hline 0.53634$$

Number corresponding to log 3.49.

$$\text{Log of } 127 = 2.10380$$

$$\div 2.5 = 0.84152.$$

And for the cross streets in the other portion of the town to deliver a quantity equal to 34,285 gallons in 24 hours, or say 24 gallons per minute in every 220 yards.

As

Diameter
in inches.

$$\sqrt[2.5]{127} : \sqrt[2.5]{24} :: 5.16 : 2.57, \text{ say 3 inches.}$$

By logarithms:—

$$1.38021$$

$$\div 2.5 = 0.55208$$

$$\text{Log } 5.16 \quad 0.71264$$

$$\hline 1.26472$$

$$\div \text{log of } \sqrt[2.5]{127} \quad 0.84152$$

$$\hline 0.42320$$

Number corresponding to log 2.65.

From these calculations and the diagram it is evident, therefore, that the streets F S, G R, J P should be laid with 4-inch pipes through the most populous parts, and 3-inch for the other parts.

With regard to the leading main or supply conduit from the *storage* reservoir to the service reservoir, it should always be large enough to convey the full quantity of water which it is estimated can be derived from the drainage area, rendering necessary an extension only of reservoir room when the population requires an increased supply, a much less costly work generally than a duplication of the pipe lines.

To check the former computations to see that the *theoretical* dimensions of the main are large enough for the passage of the water required, we may reverse the previous calculations, and estimate the loss of head occasioned by each branch-pipe and the main pipe.

For calculating the loss of head in the street mains, it is best to first find the proportional discharge of each pipe, the 10-inch main (theoretical diameter 10 inches) being assumed at 667 gallons, or the total quantity for the first 220 yards above the 5-inch main.

On this assumption, therefore, and taking the *theoretical* dimensions of the mains, the 10-inch main will discharge 667 gallons per minute at street C D. The discharge of the 5-inch main will therefore be

$$\text{as } 10^{2.5} : 5 \cdot 16^{2.5} :: 667 : 127 \text{ gallons per minute.}$$

The discharge will therefore be, for the portion of 10-inch main between U T and F S, taking at first only 220 yards of main to facilitate calculation, 540 gallons per minute.*

* Only 220 yards of each main is at first dealt with, so that Rule [60] may be applied, for this rule is only applicable when the *head* and *length* are constant. The total heads required are found afterwards by proportion, using Rule [61], as will be seen hereafter; the quantities 540, 501, 459, &c., are, therefore, only *assumed* quantities for the purpose of continuing the calculation.

For the next 220 yards the quantity to be deducted will be
as $10^{2.5} : 3 \cdot 49^{2.5} :: 540 : 39$ gallons per minute.

Therefore for the space between F S and G R of the 9-inch main the discharge will be 501 gallons per minute.

For the next 220 yards the quantity to be deducted will be
as $9 \cdot 4^{2.5} : 3 \cdot 49^{2.5} :: 501 : 42$ gallons per minute.

Therefore for the space between G R and H Q, or the 8-inch main, the discharge will be 459 gallons per minute.

For the next 220 yards the quantity to be deducted will be

as $8 \cdot 27^{2.5} : 5 \cdot 64^{2.5} :: 459 : 176$ gallons per minute.

Therefore for the space between H Q and J P along the 7-inch main a quantity (assumed) of 283 gallons per minute will pass.

This will be again reduced at cross street J P by

as $6 \cdot 8^{2.5} : 3 \cdot 49^{2.5} :: 283 : 53$ gallons per minute.

The quantity passing along the 6-inch main will therefore be 230 gallons per minute.

This will be again reduced at cross street K V to

as $5 \cdot 6^{2.5} : 3 \cdot 49^{2.5} :: 230 : 70$ gallons per minute.

We have now to find the proportional discharges of 220 yards of the 3-inch and 4-inch mains in the upper part of the town not yet done.

| | | | Gals. per min. |
|--------------|-----------------|--|-------------------|
| For 220 yds. | 4-in. in street | U T, as $5 \cdot 16^{2.5} : 3 \cdot 49^{2.5} ::$ | 79 : 90 |
| " | " | 3-in. " F S, as $3 \cdot 49^{2.5} : 2 \cdot 65^{2.5} ::$ | 39 : 19 |
| " | " | 3-in. " G R, as $3 \cdot 49^{2.5} : 2 \cdot 65^{2.5} ::$ | 42 : 21 |
| " | " | 4-in. " H Q, as $5 \cdot 64^{2.5} : 3 \cdot 49^{2.5} ::$ | 176 : 53 |
| " | " | 3-in. " J P, as $3 \cdot 49^{2.5} : 2 \cdot 65^{2.5} ::$ | 53 : 27 |
| " | " | 3-in. " K V, as $3 \cdot 49^{2.5} : 2 \cdot 65^{2.5} ::$ | 70 : 35 |
| " | " | 4-in. " D L, as $5 \cdot 16^{2.5} : 3 \cdot 49^{2.5} ::$ | 127 : 48 |
| " | " | 3-in. " E I, as $3 \cdot 49^{2.5} : 2 \cdot 65^{2.5} ::$ | 30 : 15 |

From these calculations we shall be able to compute the probable comparative heads lost in all the mains for 220 yards of those mains, and so the total head by Rule [61].

The head required for the 10-inch main from the *service* reservoir to the point C on plan will be for the discharge of 667 gallons per minute, taking only the theoretical diameter.

$$\frac{667^2 \times 880}{(3 \times 10)^5} = 16 \cdot 11.$$

Head required.
Feet.

We will now find out the head required for each 220 yards of the different mains for the proportional discharges before calculated, and assuming the 220 yards of 10-inch main as the standard discharging 667 gallons per minute for the purposes of the calculation.

| | | | | Head re- quired for 220 yards. Feet. |
|--------------------------------|----------|----------|--|---|
| For 5 in. theoretical diameter | 5.16 in. | | $\frac{127^2 \times 220}{(3 \times 5.16)^5}$ | = 3.99 |
| „ 4 in. | „ | 3.49 in. | $\frac{39^2 \times 220}{(3 \times 3.49)^5}$ | = 2.66 |
| „ 4 in. | „ | 3.49 in. | $\frac{42^2 \times 220}{(3 \times 3.49)^5}$ | = 3.08 |
| „ 6 in. | „ | 5.64 in. | $\frac{176^2 \times 220}{(3 \times 5.64)^5}$ | = 4.91 |
| „ 4 in. | „ | 3.49 in. | $\frac{53^2 \times 220}{(3 \times 3.49)^5}$ | = 4.91 |
| „ 4 in. | „ | 3.49 in. | $\frac{70^2 \times 220}{(3 \times 3.49)^5}$ | = 8.57 |
| „ 10 in. | „ | 10 in. | $\frac{540^2 \times 220}{(3 \times 10)^5}$ | = 2.64 |
| „ 9 in. | „ | 9.4 in. | $\frac{501^2 \times 220}{(3 \times 9.4)^5}$ | = 3.09 |

| | | | | Head re- quired for 220 yards. Feet. |
|--------------------------------|----------|----------|--|---|
| For 8 in. theoretical diameter | 8.27 in. | | $\frac{459^2 \times 220}{(3 \times 8.27)^5}$ | = 4.93 |
| „ 7 in. | „ | 6.8 in. | $\frac{283^2 \times 220}{(3 \times 6.8)^5}$ | = 4.98 |
| „ 6 in. | „ | 5.6 in. | $\frac{230^2 \times 220}{(3 \times 5.6)^5}$ | = 8.69 |
| Street. | | | | |
| U T 4 in. | „ | 3.49 in. | $\frac{30^2 \times 220}{(3 \times 3.49)^5}$ | = 1.57 |
| F S 3 in. | „ | 2.65 in. | $\frac{19^2 \times 220}{(3 \times 2.65)^5}$ | = 2.50 |
| G R 3 in. | „ | 2.65 in. | $\frac{21^2 \times 220}{(3 \times 2.65)^5}$ | = 3.05 |
| H Q 4 in. | „ | 3.49 in. | $\frac{53^2 \times 220}{(3 \times 3.49)^5}$ | = 4.91 |
| J P 3 in. | „ | 2.65 in. | $\frac{27^2 \times 220}{(3 \times 2.65)^5}$ | = 5.05 |
| K V 3 in. | „ | 2.65 in. | $\frac{35^2 \times 220}{(3 \times 2.65)^5}$ | = 8.48 |
| D L 4 in. | „ | 3.49 in. | $\frac{48^2 \times 220}{(3 \times 3.49)^5}$ | = 4.03 |
| E I 3 in. | „ | 2.65 in. | $\frac{15^2 \times 220}{(3 \times 2.65)^5}$ | = 1.56 |

From these calculations we can now determine the head lost in all the mains, on the same assumption of 667 gallons per minute being discharged, and if our calculations have been done correctly, this should agree with the allowance assumed (see pages 35 to 39), being 4 feet in every 220 yards, plus the head required for the passage of 667

gallons per minute through the 10-inch main from the *service* reservoir to the street U T, viz. 10,780 yards, divided by 220 and multiplied by 4, or equal to 196 feet, and adding 16·11, the head required for the 10-inch main to street U T, brings up a *total* of 212·11 *feet*, with which the following calculations of *total head* required should agree.

The heads are calculated by Rule [61].

| Street. | | | | Total head required. Feet. |
|-------------|-----|-----------------|----------------------|----------------------------------|
| U T | for | 5-inch main, as | 220 : 440 :: 3·99 : | 7·98 |
| F S | „ | 4 „ | 220 : 440 :: 2·66 : | 5·32 |
| G R | „ | 4 „ | 220 : 440 :: 3·08 : | 6·16 |
| H Q | „ | 6 „ | 220 : 440 :: 4·91 : | 9·82 |
| J P | „ | 4 „ | 220 : 440 :: 4·91 : | 9·82 |
| K V | „ | 4 „ | 220 : 440 :: 8·57 : | 17·14 |
| CM | „ | 10 „ | 220 : 220 :: 2·64 : | 2·64 |
| CM | „ | 9 „ | 220 : 220 :: 3·09 : | 3·09 |
| CM | „ | 8 „ | 220 : 220 :: 4·93 : | 4·93 |
| CM | „ | 7 „ | 220 : 220 :: 4·98 : | 4·98 |
| CM | „ | 6 „ | 220 : 220 :: 8·69 : | 8·69 |
| U T | „ | 4 „ | 220 : 440 :: 1·57 : | 3·14 |
| F S | „ | 3 „ | 220 : 440 :: 2·50 : | 5·00 |
| G R | „ | 3 „ | 220 : 440 :: 3·05 : | 6·10 |
| H Q | „ | 4 „ | 220 : 440 :: 4·91 : | 9·82 |
| J P | „ | 3 „ | 220 : 440 :: 5·05 : | 10·10 |
| K V | „ | 3 „ | 220 : 440 :: 8·48 : | 16·96 |
| D L and B N | „ | 4 „ | 220 : 2200 :: 4·03 : | 40·30 |
| E I and A O | „ | 3 „ | 220 : 2200 :: 1·56 : | 15·60 |

187·59

Add 4 feet for passing 667 gallons per minute to }
street F S (see page 40) } 4·00

Add 16·11 feet per head required in 10-inch main 16·11

Total head in feet and decimals 207·70

Or a difference of only 4·41, or $2\frac{1}{4}$ per cent., from the total head assumed in calculating the distribution pipes. We are

now, therefore, enabled by Rule [59] to calculate the actual demand which, if made on the town at one second of time, still assuming the theoretical diameters, would give a clear head of 20 feet over the tops of the houses at the highest point in the district under consideration, viz. the 90 feet contour line, as follows:—

| | Gallons per minute. | Gallons per minute. |
|---|------------------------|------------------------|
| As $\sqrt{207 \cdot 70} : \sqrt{50} ::$ | 667 | 327. |

The reticulation of this town may therefore be considered sufficient for a supply *at the rate of*, with the theoretical diameters, $327 \times 60 \times 24 = 470,880$ gallons in 24 hours, with the service reservoir at its present level, or equal to the improbable contingency of the *whole* population drawing off the total supply of 40 gallons per head continuously in about 9 hours, and still affording a pressure, in case of fire, of 20 feet above the tops of the houses, and equal also to a possible emergency of 1760 yards of houses drawing off the whole of their *proportionate supply* in four hours.

Having now gone into this subject as fully and as accurately as the circumstances of the case will allow, a few general remarks may be useful to the reader.

1st. Where the town is very irregular in levels, or many suburbs lying at some distance from it have to be supplied, and where, therefore, an excessive pressure would be given in the lower portions of the town by placing the *service* reservoir at a sufficient height above the higher portions, it is best to supply the town under different zones of pressure, as is to my own knowledge done in Manchester and Halifax, England. Where also, from the large increase of a town population, the higher parts do not obtain a sufficient pressure, a series of service reservoirs may be constructed for each district; these are then filled in the night, and in the day the head, which would otherwise be lost in passing the water to the higher districts through the branch mains and other reticulation, is gained for the supply of the districts

in question; each case, of course, varies, and demands its own special considerations; but the principle, such as I have laid down for determining the sizes of the distribution mains, remains the same.

2nd. The position of valves, fire-cocks, &c., are not shown in the diagram, it would be foreign to the object of this work to so show them; the valves should be placed so that as little of the town supply should be shut off as possible during the attaching of services or the occasional necessary repairs required.

3rd. In designing the mains or conduits for the supply, a special difference always exists in the supply main *from* the *storage* reservoir to the *service* reservoir, and the supply main *from* the *service* reservoir to the town. The first named has to supply a *constant* quantity in the case before us of 160,000 gallons in 24 hours. The second named has to supply a *variable* quantity and must be proportionate to the greatest estimated hourly draught, or in our case *at the rate* of 960,000 gallons in 24 hours.

4th. The larger the *service* reservoir the better, of course, three or four days supply at the *greatest estimated hourly demand* is usually considered sufficient to allow of any stoppage between the storage and service reservoirs.

5th. The distribution pipes should always be connected with the main supply from the *storage* reservoir in case of repairs being required to the *service* reservoir, or in case of cleansing, &c.

6th. The main object of a *service* reservoir is to equalise the distribution and *reduce* the supply main from the storage reservoir to a minimum (see 3rd remark).

7th. All the pipes should be connected with each other in the system of distribution, so that the water may have a free flow, and as few dead ends put in as possible; in fact, where it is necessary to put an end to the pipe, a branch or turn-up fire-cock should be placed so that the mains may be scoured occasionally.

Note referred to on page 42.—The *proportional* discharges

vary from those for which the diameters of the mains were calculated, owing to the assumed *constant* flow of water of 667 gallons per minute being distributed amongst them according to their diameters. The check of the whole work is that the *total head* calculated from these *proportional* discharges agrees to $2\frac{1}{4}$ per cent. with the total head required, by allowing 4 feet loss of head in every 220 yards of street main in the town in question.

It may be remarked that the *proportional* quantity which would flow down the actual *practical* mains laid may be easily obtained from the *proportional* quantities previously given for the theoretical mains by Rule [60]; for instance, supposing we require to know the actual *proportional* discharge at the end of each 220 yards of the 6-inch main in street H Q, the proportional discharge through the theoretical diameter being 176 gallons per minute, we have

$$5 \cdot 64^{2.5} : 6^{2.5} :: 176 : 205 \text{ gallons per minute.}$$

The discharge of the 6-inch pipe is therefore 205 gallons per minute.

To those who are unacquainted with the use of logarithms, which are necessary to work all hydraulic calculations easily, I would recommend 'Chambers' Mathematical Tables'; they should also take one or two lessons from one competent to teach, and this will probably be found sufficient.

ON THE FLOW OF WATER THROUGH SIPHON PIPES.

PLATE VI.

The siphon is illustrated on Plate VI., Diagram (1), and its action may be thus explained. It has been found that a column of water 33 or 34 feet high in a hollow tube, wherein a vacuum has been formed, can be supported by the pressure of the atmosphere upon a water surface, and if we suppose that at the highest portion of the siphon *c*, Diagram (1), a partition *d* is placed, the column between *c* and A B will not only be supported, but it will be forced against the partition *d* with a force equal to the weight of a similar column having

a base d and a height of from 33 to 34 feet, less the difference of level between the higher water surface $A B$ and the partition d .

But if the siphon be filled with a fluid, the opposite side of the partition d is acted upon by a column with the base d and a height equal to 33 or 34 feet, less the difference of level between d and the surface of the water $D E$. It is evident, therefore, that this last pressure is less than the first, and the consequence is, that if no partition existed, as none does exist in the siphon, the liquid section at the highest portion of the siphon would be forced forward in the direction $F C D$ by a force equal to the difference of the levels of the water surfaces $A B$ and $D E$.

The head, therefore, to be taken in calculating the discharge of a siphon when uncovered at the low end is the difference of level between the surface of the water at its inlet and the centre of the end of the long leg, or difference between $A B$ and F , and when both ends are submerged the difference between the upper and lower waters, or difference between $A B$ and $D E$, and it is necessary in large siphons to have the lower leg immersed to prevent the accumulation of air in the lower leg, which would cut off the column.

For calculating the discharge through a siphon pipe, three things must be considered : the head due to velocity of entry, the head due to friction, and the head due to the bend at its summit ; and the best plan is, when the diameter, length, and radius of bend and head are given, to calculate the heads required on an *assumed* discharge for velocity of entry, bends, and friction, and add them together, afterwards finding the true discharge by Rule [59] (see example in Appendix of examples to this work).

When the length, head, discharge, and radius of bend are given, and the diameter is required, *assume* any diameter and calculate the heads required with this diameter, and the known discharge and length, for velocity of entry, bends, and friction ; then by Rule [62] find out what the diameter should be with the true head (see example in Appendix).

For *inverted* siphons both ends are usually submerged, and the head is the difference of level between the upper and lower waters. Rules [52] to [55] inclusive are used for friction, Rules [47] to [49] for velocity of entry if a coefficient of 0.817 is required, if not [46] reversed must be used, or

$$\left\{ \left(\frac{D}{A} \div c \right) \div 8.025 \right\}^2 = H; \quad [66]$$

in which

D = discharge in cubic feet per second ;

A = area in square feet ;

c = coefficient according to circumstances ;

H = head in feet.

For bends use Rules [58A] and [58B].

The same rules may be used for siphons *proper*.

Square siphon pipes, often used for drainage, &c., can be assimilated to round ones (see page 32).

It may be mentioned that the practical depth to which a siphon *proper* should be designed to draw should seldom exceed 25 or 26 feet.

CHAPTER V.

ON THE FLOW OF WATER FROM JETS, AND THE HEIGHTS ATTAINED BY DIFFERENT DIAMETERS OF JET.

ON this subject there are few experiments. From the best we have it would appear that, although theoretically the jet should rise to a height H , owing to the resistance of the air it only attains a height H^1 , and that the *difference*, or H^2 , increases with the absolute height of the jet and diminishes with an increase in the diameter. It is also found that H^2 increases nearly in the ratio of the *square of the head*, and that the curve obtained from different heights of jet having the same diameter approaches nearly to that of a parabola, and that the *head being constant*, H^2 varies in *inverse ratio* to the *diameter* of the jet.

From these observed facts, therefore, we may obtain a formula which, from the experiments at hand, is the nearest approximation obtainable, which is as follows:—

$$H^1 = \frac{H}{d} \times .0124; \quad [67]$$

in which

H = the head on the jet in feet;

H^1 = the difference between the height of head and height of jet;

d = the diameter of the jet in $\frac{1}{16}$ ths of an inch.

The discharge of jets of course varies with the form of the nozzle, and may be calculated by the formula

$$G = \sqrt{H} \times d^2 \times 0.22 \quad [68]$$

for a nozzle of a good form where the coefficient of discharge

is equal to 0·943 of the theoretical discharge, and the coefficient 0·22 in the above formula must be altered to suit the case. Some nozzles require a coefficient of only 0·18. In the above rule

H = the head of water in feet on the jet;

d = the diameter in $\frac{1}{8}$ ths of an inch;

G = gallons discharged per minute.

When a jet occurs at the end of a long main, the head for passing the water through that main must be deducted, and the actual nett head on the jet taken. The discharge may in the first case be *assumed* as before shown, and the true result obtained by Rules [59], &c.; and as this system of calculation has been so often shown and referred to, it is unnecessary to here repeat it.

There are many interesting theories with regard to the paths of jets from oblique and straight nozzles, but as they are not of much value in practice, I omit them.

If mains are laid in a town, it may be mentioned that it would not be necessary then to calculate the head lost up to the point where the jet is wished to be played, as an application of the *pressure gauge* to the main during the hours of *greatest draught* would give the working pressure available for the playing of the jet.

CHAPTER VI.

PLATE VII.

ON THE FLOW OF WATER THROUGH CANALS, RIVERS, AQUEDUCTS, ETC.

Long Channels.—The theoretical velocity of water flowing through canals, &c., may be found by the formula,

$$\sqrt{HMD \times F} = V \quad [69]$$

and the actual discharge by

$$D = \sqrt{HMD \times F} \times c \times A; \quad [70]$$

in which

D = discharge in cubic feet per second;

V = velocity in feet per second;

HMD = the hydraulic mean depth or the area divided by the wetted perimeter;

F = the fall in 2 miles in feet;

c = a coefficient, according to circumstances;

A = the area in square feet.

Formula [70] is only applicable to *long* channels.

With regard to the coefficient c for large channels unencumbered with the growth of aquatic plants, and regular in their form, it may be taken as 0.84; for smaller channels in the same condition, as 0.75; but where the growth of aquatic plants is great, M. Girard conceives it necessary to multiply the wetted perimeter by 1.7 before dividing it into the area in order to obtain the hydraulic mean depth, so that for channels where the growth of these plants is great the hydraulic mean depth must be found as follows:—

$$HMD = \frac{A}{P \times 1.7}; \quad [71]$$

in which

A = the area in square feet;

P = the perimeter, or *wetted* border, in feet.

Short Channels.—Nothing, however, could be more erroneous than to use the formula where the channel is short, for instance, for a short culvert under a road, or for a flume across a stream, for then the head for velocity of entry must be considered. The best way in the case of a short flume or culvert, is to calculate the head for velocity of entry and friction separately for an *assumed* discharge, and add them together, then the true discharge may found by Rule [59].

For example.—What head must be given to a *short* aqueduct or culvert flume 50 feet long and 8 square feet area, and perimeter 8 lineal feet, to discharge 40 cubic feet per second, coefficient 0.75?

For velocity of entry.

$$\text{By rule [66]} \left\{ \left(\frac{40}{8} \div 0.75 \right) \div 8.025 \right\}^2 = \text{Head in feet.} \\ = 0.67568.$$

For friction, formula [70] reversed can be used, or

$$\left(\frac{D}{A \div c} \right)^2 \div H M D = F; \quad [72]$$

\therefore in our case

$$\left(\frac{40}{8} \div 0.75 \right)^2 \div 1 = \frac{\text{Fall in 2 miles.}}{43.54}.$$

The fall, therefore, in 50 feet will be

Fall in 50 feet.

$$\text{As } 10560 : 50 :: 43.54 : 0.20615$$

Add head for velocity of entry before obtained = 0.67568

$$\text{Total fall required in flume} = 0.88183$$

If the discharge had been *required* for the above flume, the head being given, it must be calculated as follows:—

Assume a discharge of say 32 cubic feet per second.

For velocity of entry.

$$\left\{ \left(\frac{32}{8} \div 0.75 \right) \div 8.025 \right\}^2 = \text{Head in feet.} \\ = 0.4417.$$

For friction.

$$\left(\frac{32}{8} \div 0.75\right)^2 \div 1 = \frac{\text{Fall in 2 miles.}}{28.4441}$$

Then

Fall in 50 feet.

$$\text{As } 10560 : 50 :: 28.4441 : 0.1346$$

$$\text{Add head for velocity of entry before obtained} \quad 0.4417$$

$$\text{Total head required for 32 cube feet per second} = 0.5763$$

The actual given head being 0.88183 feet, we have by Rule [59]

$$\begin{aligned} \sqrt{0.5763} : \sqrt{0.88183} :: 32 : \text{Actual discharge in} \\ \text{cube feet per second.} \\ = \frac{0.939 \times 32}{0.7591} = 39.61 \end{aligned}$$

as against 40 cube feet per second, the difference arising from not carrying out the decimal places far enough.

If the given head of 0.88183 had been taken, and the discharge taken by formula [70], we should have had

$$\begin{aligned} &\text{Discharge in cube} \\ &\text{feet per second.} \\ \sqrt{1 \times 186.24} \times 0.75 \times 8 &= 81.84, \end{aligned}$$

or more than double the true discharge, by not allowing for the velocity of entry.

This should be studied well, as mistakes are frequently made, for it will be seen that the head in the case cited to produce velocity of entry is actually greater than that required for friction, and therefore the head for velocity of entry should always be calculated until the length of the channel becomes so great that it bears such a slight proportion to the frictional head that it may be neglected; even *long channels* or aqueducts should be made rather wider at their entrances, and approach the "Vena Contracta" form as nearly as possible, to allow for the slight head required for velocity of entry.

On Contractions in River Channels.—When the banks of a river whose bed has a uniform inclination approach each other and contract the width of the channel in any way, as in Figs. 1 and 2, Plate VII., the water will rise in the channel above the contracted portion A, until the increased velocity of discharge compensates for the reduced cross section.

If we put d_1 for the increase of depth immediately above the contracted width in feet, and d_2 for the previous depth of the channel in feet, we shall find the quantity of water passing through the lower depth d_2 equal to

$$c \times l \times d_2 \times 8.025 \sqrt{d_1}; \quad [73]$$

in which l is the width of the contracted portion at A, and c a coefficient according to circumstances, and the quantity of water overflowing through d_1 equal to

$$\frac{2}{3} \times c \times b \times d_1 \times \sqrt{d_1} \times 8.025; \quad [74]$$

and hence the whole discharge through A is equal to

$$D = c \times l \times 8.025 \sqrt{d_1} \times (d_2 + \frac{2}{3} \times d_1); \quad [75]$$

in which

D = the discharge in cubic feet per second;

c = a coefficient according to circumstances;

l = the width of the contracted portion at A in feet;

d_1 and d_2 as shown on diagram and before stated.

When the object is to find the width l of the contracted channel so that the depth of water in the upper reach shall be increased by a given depth d_1 , we shall find

$$l = \frac{D}{c \times 8.025 \sqrt{d_1} \times (d_2 + \frac{2}{3} \times d_1)}; \quad [76]$$

signification of letters as in Rule [75].

ON VELOCITY OF APPROACH.

When the velocity of approach is considerable, or when the height h due to it becomes a large portion of d_1 , its effect

must not be neglected. In this case, as before, we find the discharge through the depth d_2 equal to

$$D = c \times l \times d_2 \times 8.025 \times \sqrt{(d_1 + h)} \quad [77]$$

and the discharge through the depth d_1 equal to

$$D = \frac{2}{3} \times c \times l \times 8.025 \times \{ (d_1 + h)^{1.5} - h^{1.5} \}, \quad [78]$$

and hence the whole discharge is

$$D = c \times l \times 8.025 \times \{ d_2 \times \sqrt{(d_1 + h)} + \frac{2}{3} \times [(d_1 + h)^{1.5} - h^{1.5}] \}, \quad [79]$$

from which we may obtain

$$l = \frac{D}{c \times 8.025 \times \{ d_2 \times \sqrt{(d_1 + h)} + \frac{2}{3} \times [(d_1 + h)^{1.5} - h^{1.5}] \}}; \quad [80]$$

in which h equals the head in feet due to velocity of approach, and the other letters have the same signification as in Formula [75]. If the projecting spur at A be itself submerged, these formulæ can be extended by finding the discharges of the different sections according to the formula given and adding them together; this is so simple, and the resulting formula so lengthy to commit to paper, that they are omitted.

These formulæ are also applicable to cases of contraction of river channels caused by the construction of bridge piers and abutments, when the width l is put for the sum of the openings between them. The value of the coefficient will depend on the circumstances of the case.

For piers square to the channel take 0.6

When the angles of the cutwaters are obtuse take 0.7

And when curved and acute take 0.8

APPENDIX I.

PLATES VIII. AND IX.



THE water supplied to miners from the races of the Victoria Government is given in three ways:—

1st. Through a gauge box, with a pipe of a length equal to two diameters attached, as shown in the Diagrams, No. 1, 2, 3, Plate VIII.

2nd. Through a siphon pipe from the channel, as illustrated in Diagrams 4, 5, Plate VIII.

3rd. Through a sluice-gate opening of known dimensions, and with a stated head kept on it, Diagrams 1, 2, 3, Plate IX. The modes of calculating the quantity of water passed for these three different methods will now be dealt with in as simple a manner as the subject admits of.

For calculating the quantity of water passed through a short pipe of two diameters, with square edges, attached to a box, as shown in the Diagrams 1, 2, 3, Plate VIII., the following formula may be used:—

$$G = \sqrt{H} \times d^2 \times 13,$$

which, when the diameter is required, may be stated

$$d = \sqrt{\left(\frac{G}{\sqrt{H} \times 13}\right)}$$

and when the head is required

$$H = \left(\frac{G}{d^2 \times 13}\right)^2,$$

where

G = gallons per minute ;

H = head in feet ;

d = diameter in inches.

The Table, No. VII., is calculated from this rule, and can be extended as follows, this extension being based on one of the laws which govern pipes (see Chapter IV. of this work).

Rule.—The discharge of any pipe or series of pipes is proportional to the square root of the head when the length and diameter are constant; therefore, supposing we wanted the discharge through a 4-inch pipe with 4 feet head, we have by the table for one [1] foot head 208 gallons per minute; therefore, for 4 feet head the discharge will be

$$\text{As } \sqrt{1} : \sqrt{4} :: 208 : 416 \text{ gallons per minute.}$$

By logarithms.

$$\begin{array}{r} \text{Log of 4} = 0.6020600 \\ \hline \text{Log. of 1} = 0.0000000 \div 2 \quad 0.3010300 \\ \div 2 = 0.0000000 \text{ log of 208} = 2.3180633 \\ \hline 2.6190933 \\ \text{Log } \sqrt{1} = 0.0000000 \\ \hline 2.6190933 \end{array}$$

Number corresponding to log 416

2. In calculating the quantity of water passed through a siphon pipe similar to the one shown in Plate VIII., Diagrams 4, 5, three things should actually enter into the calculation :—

- 1st. The head due to velocity of entry.
- 2nd. The head due to the bend at the top.
- 3rd. The head due to friction in the pipe.

But as the formula for obtaining the second is very complicated, and as if a large radius is given to the bend, it does not make much difference in the practical result, it may be omitted by the practical miner.

For the first head we shall have, therefore,

$$H = \left(\frac{G}{d^2 \times 18} \right)^2$$

and for the third

$$H = \frac{G^2 \times L}{(3 \times d)^5}.$$

Taking the siphon as shown in Diagrams 4, 5, Plate VIII., we will assume at first that the discharge will be 100 gallons per minute; therefore, neglecting the bend,

For velocity of entry.

$$\left(\frac{100}{2.75^2 \times 18} \right)^2 = \text{Head in feet required.}$$

For friction.

$$\frac{100^2 \times 22}{(3 \times 2.75)^5} = 5.75640$$

$$\text{Total head} \quad \dots \quad 5.76674$$

By logarithms.

| | |
|--|--|
| Log of 100 = 2.0000000 | Log of 2.75 = 0.4393327 |
| Log of $2.75^2 \times 18 = 1.9926088$ | × 2 2 |
| <hr/> | <hr/> |
| 0.0073912 | 0.8786654 |
| × 2 2 | × 18 1.1139434 |
| <hr/> | <hr/> |
| 0.0147824 | 1.9926088 |
| Number corresponding .01034 | |
| Log of 100 = 2.0000000 | Log of 2.75 = 0.4393327 |
| × 2 2 | ” ” 3 = 0.4771213 |
| <hr/> | <hr/> |
| 4.0000000 | 0.9164540 |
| × 22 1.3424227 | × 5 5 |
| <hr/> | <hr/> |
| 5.3424227 | 4.5822700 |
| Log of $(3 \times 2.75)^5 = 4.5822700$ | |
| <hr/> | |
| 0.7601527 | |
| Number corresponding 5.7564 | |

Then by the rule before mentioned we have

$$\text{As } \sqrt{5.76674} : \sqrt{10} :: 100 : \text{Gallons per minute required. } 131.68$$

By logarithms.

| | |
|------------------------------------|-----------------------|
| | Log of 10 = 1.0000000 |
| | ÷ 2 0.5000000 |
| | × 100 2.0000000 |
| Log of 5.76674 = 0.7609274 | 2.5000000 |
| For square root ÷ 2 = 0.3804637 | 0.3804637 |
| | 2.1195363 |
| Number corresponding to log 131.68 | |

The discharge through the siphon pipe is therefore, neglecting the bend at the summit, nearly 132 gallons per minute if it is wished to include the bend (see Chapter IV., on pipes and siphon pipes); if the head required for the bend were added, if it is of a *large radius* the difference would be practically nothing, but if of small radius it should be added, as it would reduce the discharge.

3. In calculating the quantity of water passed through a sluice *gate* with side walls, as in the Diagram 1, 2, 3, Plate IX., the formula to be used for obtaining the number of gallons per minute with a given head and opening is

$$G = 8.025 \times \sqrt{H} \times .6 \times A \times 6.23 \times 60,$$

and for the head required on a certain opening to give a certain discharge,

$$H = \left\{ \frac{\left(\frac{G}{6.23 \times 60 \div A} \right) \div c}{8.025} \right\}^2.$$

For example.—What will a sluice gate opened 1 foot and 3 feet wide discharge with a head to the *centre* of the orifice of 1 foot? By the formula

$$8 \cdot 025 \times \sqrt{1} \times \cdot 6 \times 3 \times 6 \cdot 23 \times 60 = 5399 \cdot 54 \quad \text{Gallons per minute.}$$

| | |
|---------|-------------|
| 8·025 | 14·4450 |
| 1 | 6·23 |
| 8·025 | 433350 |
| ·6 | 288900 |
| 4·8150 | 866700 |
| 3 | 89·992350 |
| 14·4450 | 60 |
| | 5399·541000 |

or a little over $5399\frac{1}{2}$ gallons per minute.

If the head had been required to pass 5399·54 gallons per minute through a sluice opening of 1 foot \times 3 feet,

By formula

$$\left\{ \frac{\left(\frac{5399 \cdot 54}{6 \cdot 23 \times 60} \div A \right) \div c}{8 \cdot 025} \right\}^2 = 1 \text{ foot.}$$

$$\begin{array}{r} 6 \cdot 23 \\ 60 \\ \hline \end{array}$$

$$\begin{array}{r} 373 \cdot 80 \overline{) 5399 \cdot 54} \\ 37380 \\ \hline \end{array}$$

$$\begin{array}{r} 166154 \\ 149520 \\ \hline \end{array}$$

$$\begin{array}{r} 166340 \\ 149520 \\ \hline \end{array}$$

$$\begin{array}{r} 168200 \\ 149520 \\ \hline \end{array}$$

$$\begin{array}{r} 186800 \\ 186900 \\ \hline \end{array}$$

$$3 \overline{) 14 \cdot 4450}$$

$$\cdot 6 \overline{) 4 \cdot 8150}$$

$$8 \cdot 025 \overline{) 8 \cdot 025}$$

$$1 \cdot 000$$

and the square of 1 is one; therefore
the head required is one (1) foot.

The water may occasionally be supplied from a *sluice* valve (see Plate IX., Diagram 4), and then the following formulæ are applicable, assuming that a length of pipe of not more than 2 to 3 diameters is attached to it, for if more pipe is attached, then the friction in the pipe also must be taken into account (see Chapter IV. of this work). Assuming, therefore, that the pipe is not longer than twice or three times the diameter of the *sluice* valve we may use

$$G = \sqrt{H} \times d^2 \times 10$$

$$H = \left(\frac{G}{d^2 \times 10} \right)^2$$

$$d = \sqrt{\left(\frac{G}{\sqrt{H} \times 10} \right)}$$

For example.—What is the discharge of a *sluice* valve 4 inches in diameter with a head on the *centre* of the valve of 1 foot? By the formula

$$\begin{aligned} & \sqrt{1} \times 4^2 \times 10 \\ &= 1 \times 16 \times 10 \\ &= 16 \times 10 \\ &= 160 \text{ gallons per minute.} \end{aligned}$$

If the head is required to discharge 160 gallons per minute, we have

$$\begin{aligned} & \left(\frac{160}{4^2 \times 10} \right)^2 \\ &= \frac{160}{160} = 1 \text{ foot.} \end{aligned}$$

For *diameter* we have

$$\begin{aligned} & \sqrt{\left(\frac{160}{\sqrt{1} \times 10} \right)} \\ &= \sqrt{\frac{160}{10}} \\ &= \sqrt{16} = 4 \text{ inches.} \end{aligned}$$

Mode of reading the Water Meter.—The water meter index is represented on Plate IX., Diagram 5, and is read as follows:—The pointer (A) has reference to the outer or “tens” circle divided into ten equal parts of 100 gallons each, numbered 100, 200, &c., to 1000, and each divided into ten equal parts of 10 gallons each. The large central hand B has reference to the inner or “thousand” circle divided into ten equal parts of 10,000 gallons each, numbered 10, 20, &c., to 100, and each divided into ten equal parts of 1000 gallons, the whole revolution of the hands showing 100,000 gallons. In addition to these hands, another hand C, complete in a dial of its own, measures 1,000,000 gallons for a complete revolution, each division (of which there are ten) numbered from 1 to 10, showing 100,000 gallons. In order to estimate the quantity of water which has passed through the meter, the various amounts as registered by the various hands must be added together, care being taken only to count completed divisions; thus, in the diagram the hand C has completed one division of 100,000 gallons, the hand B has completed 70 divisions of 1000 gallons each, making 70,000 gallons, the pointer A stands at 500 gallons, and has consequently registered 500 gallons, therefore we have

| | | |
|---------------|---|---------|
| Hand | C | 100,000 |
| ” | B | 70,000 |
| Pointer | A | 500 |
| | | <hr/> |
| Total gallons | | 170,500 |

170,500 gallons is therefore the quantity which has passed through the meter since all the hands stood at 0. Sometimes another small dial is added registering 10,000,000 gallons, but the principle of adding the registers of each finger and the pointer together remains the same. Where a meter does not stand at 0 when it is fixed, it is necessary to record its reading, this reading is then subtracted from any future reading, and the result is the number of gallons passed since the meter was fixed.

APPENDIX II.

CONTAINING EXAMPLES NOT GIVEN IN THE BODY OF THE WORK.

EXAMPLES FOR SIPHON PIPES.

SUPPOSE a siphon *proper*, with a head of 10 feet, a diameter of 9 inches, and a length of 500 yards, and a bend of 8 feet radius at the top, what is the discharge, the inlet requiring a coefficient of 0.81? First assume a discharge of 200 gallons per minute.

Head for velocity of entry.

$$\left(\frac{200}{(13 \times 9^2)} \right) \quad \text{Head in feet.} \\ = 0.036$$

For friction.

$$\frac{200^2 \times 500}{(3 \times 9)^5} = 1.393$$

For bend.

$$\left\{ 0.131 + (1.847 \times \left(\frac{4.5}{96} \right)^{5.5}) \right\} \times \frac{1.21^2 \times 90}{960} = .001$$

Total head required for 200 gallons per minute .. 1.430

By logarithms, for velocity of entry.

$$\begin{array}{r} \text{Log of } 9 = 0.9542425 \\ \times 2 = 1.9084850 \\ \times 13 = 1.1139434 \\ \hline \text{Log of } (13 \times 9^2) = 3.0224284 \\ \text{Log of } 200 = 2.3010300 \\ \text{Log of } (13 \times 9^2) = 3.0224284 \\ \hline - 1.2786016 \\ \times 2 \quad \quad 2 \\ \hline - 2.5572032 \end{array}$$

Number corresponding to log, .036.

For friction.

| | |
|--|---|
| $\begin{array}{r} \text{Log of } 200 = 2.3010300 \\ \times 2 = 4.6020600 \\ \times 500 = 2.6989700 \\ \hline 7.3010300 \\ \text{Log of } (3 \times 9)^5 = 7.1568190 \\ \hline 0.1442110 \end{array}$ | $\begin{array}{r} \text{Log of } 3 = 0.4771213 \\ \text{Log of } 9 = 0.9542425 \\ \hline 1.4313638 \\ \times 5 \qquad \qquad 5 \\ \hline 7.1568190 \end{array}$ |
|--|---|

Number corresponding to log, 1.393.

For bend.

$$\frac{4.5}{96} = 0.047,$$

and log of this is equal to

| | |
|--|---|
| $\begin{array}{r} - 2.6720979 \\ \hline \times 3.5 = - 5.3523426 \\ \text{Log of } 1.847 = 0.2664669 \\ \hline - 5.6188095 \\ \hline \text{Number corresponding to log : } 0.00004157 \\ \text{Log of } 1.21 = 0.0827854 \\ \hline \times 2 = 0.1655708 \\ \times 90 = 1.9542425 \\ \hline 2.1198133 \\ \div 960 = 2.9822712 \\ \hline - 1.1375421 \\ \text{Log of } 0.131 = - 1.1172713 \\ \hline - 2.2548134 \\ \hline .01798 \end{array}$ | $\begin{array}{r} + 0.131 \\ \hline = 0.131 \text{ say.} \\ \hline \text{number corresponding} \\ \text{to log;} \end{array}$ |
|--|---|

$$\text{then } .01798 \div 12 = .00149.$$

Then by Rule [59] we have

$$\text{As } \sqrt{1.43} : \sqrt{10} :: 200 : 528 \text{ gallons per minute.}$$

By logarithms.

$$\begin{array}{r}
 \text{Log of } 1.43 = 0.1553360 \\
 \div = 0.0776680 \\
 \text{Log of } 10 = 1.0000000 \\
 \div 2 = 0.5000000 \\
 \times 200 = 2.3010300 \\
 2.8010300 \\
 \div \sqrt{1.43} = 0.0776680 \\
 2.7233620
 \end{array}$$

528.8 number corresponding to log ;

the siphon will therefore discharge 528 gallons per minute.

Suppose, again, we required the diameter of a siphon pipe to discharge 506.38 gallons per minute, that it was 500 yards long, and the bend the same radius, then we must assume a diameter at first ; say we assume 6 inches, then we have with this assumed diameter :—

For velocity of entry.

$$\left(\frac{506.38}{13 \times 6^2} \right)^2 = 1.17 \quad \text{Head in feet.}$$

For friction.

$$\frac{506.38^2 \times 500}{(3 \times 6)^5} = 67.850$$

For bend.

$$\left\{ 0.131 + \left(1.847 \times \left(\frac{3}{96} \right)^{3.5} \right) \right\} \times \frac{6.8 \times 90}{960} = 0.001$$

$$\begin{array}{rcl}
 \text{Total head required with 6-inch pipe for} & & \\
 506.38 \text{ gallons} \quad \dots \dots \dots & & = 69.021
 \end{array}$$

By logarithms, for velocity of entry.

$$\begin{array}{r}
 \text{Log of } 506.38 = 2.7044677 \\
 \text{,, } (13 \times 6^2) = 2.6702459 \\
 0.0342218
 \end{array}$$

$$\times 2 = 0.0684436$$

Number corresponding, 1.17.

For friction.

$$\text{Log of } 506 \cdot 38 = 2 \cdot 7044677$$

$$\begin{array}{r} \times 2 = 5 \cdot 4089354 \\ \times 500 = 2 \cdot 6989700 \end{array}$$

$$8 \cdot 1079054$$

$$\text{Log of } (3 \times 6)^5 = 6 \cdot 2763625$$

$$1 \cdot 8315429$$

Number corresponding, 67·85.

The working of the bend formula is not placed here; an example has before been given. The result is as above, 0·001 feet.

Then by Rule [62] we have

$$\sqrt[5]{10} : \sqrt[5]{69 \cdot 021} :: 6 : 8 \cdot 82 \text{ diameter;}$$

therefore with 10 feet, 500 yards length, and 506·38 gallons per minute discharge, a diameter of say 9 inches is required.

$$\text{Log. } 10 = 1 \cdot 0000000$$

$$\div 5 = 0 \cdot 2000000$$

$$\text{Log. of } 69 \cdot 021 = 1 \cdot 8389812$$

$$\div 5 = 0 \cdot 3677962$$

$$\times 6 = 0 \cdot 7781513$$

$$1 \cdot 1459475$$

$$\div \sqrt[5]{10} = 0 \cdot 2$$

$$0 \cdot 9459475$$

The number of which is 8·82.

It must be remembered that Rule [62] is only strictly applicable when the pipe is a *long* one, or at least 2000 diameters.

Examples for jets.

To what height will a jet rise with 20 feet head on the nozzle, and a nozzle of $\frac{5}{8}$ ths of an inch? By Formula [67]

$$\frac{20}{5} \times \cdot 0124 = \cdot 0496$$

Difference between height of
head and height of jet.

The jet would therefore rise 19·9504 feet.

What discharge will a $\frac{5}{8}$ ths jet give with 20 feet head on the nozzle? By Rule [68]

$$\sqrt{20} \times 5^2 \times 0\cdot22 = 4\cdot47 \times 25 \times \cdot22 = 24\cdot585$$

Gallons per minute.

The nozzle would therefore deliver a little over 24½ gallons per minute.

As Formulæ [79] and [80] are of rather a complicated nature, though unavoidably so, to those not used to written formula, I append examples.

In Plate VIII., Figs. 3 and 4, the total width of the river is 80 feet, but by the piers and abutments it is contracted to 60 feet; that is, the spaces A, B, C between the piers only measure 20 feet each, what is the discharge in cube feet per second, the theoretical velocity of approach being equal to 2 feet per second, the depth d_1 equal to 1 foot and the depth d_2 to 2 feet?

1st, the head due to the theoretical velocity of approach of 2 feet per second, corresponding to an actual velocity of about 1·91 foot per second, is

$$\frac{2^2}{64\cdot03} \text{ or equal to } \cdot 062 \text{ feet.}$$

Now by Formula [79] we have

$$\begin{aligned} & 0\cdot6 \times 60 \times 8\cdot025 \times \left\{ 2 \times \sqrt{(1 + 0\cdot062)} + \frac{2}{3} \right. \\ & \quad \left. \times [(1 + 0\cdot062)^{1\cdot5} - 0\cdot062^{1\cdot5}] \right\} \\ & = 288\cdot9 \times \left\{ 2\cdot06 + \frac{2}{3} \times [1\cdot094 - 0\cdot015] \right\} \\ & = 288\cdot9 \times \{ 2\cdot06 + 0\cdot719 \} \\ & = 288\cdot9 \times 2\cdot779 \\ & = 802\cdot85 \text{ the discharge in cube feet per second.} \end{aligned}$$

Assuming a discharge of 802·85 cubic feet per second, and the depths d_1 , d_2 the same, as also h or the head due to the velocity of approach, we have by Formula [80] for the length in lineal feet of the openings added:—

$$\begin{aligned}
 & \frac{802 \cdot 85}{\cdot 6 \times 8 \cdot 025 \times \{2 \times \sqrt{(1 + 0 \cdot 062)} + \frac{2}{3} [(1 + 0 \cdot 062)^{1 \cdot 5} - 0 \cdot 062^{1 \cdot 5}]\}} \\
 &= \frac{802 \cdot 85}{4 \cdot 815 \times \{2 \cdot 06 + \frac{2}{3} [1 \cdot 094 - 0 \cdot 015]\}} \\
 &= \frac{802 \cdot 85}{4 \cdot 815 \times \{2 \cdot 06 + 0 \cdot 719\}} \\
 &= \frac{802 \cdot 85}{4 \cdot 815 \times 2 \cdot 779} \\
 &= \frac{802 \cdot 85}{13 \cdot 38} \\
 &= 60
 \end{aligned}$$

The length of the spaces A, B, C, Diagram 3, is therefore 60 feet, as assumed in Formula [79].

On page 28 I say that the Formula 46 *reversed* should be used when a different coefficient from ·817 is required. For those unaccustomed to these matters it is here given *reversed*, as follows:—

$$\left\{ \left(\frac{D}{A} \div c \right) \div 8 \cdot 025 \right\}^2 = H;$$

where

D = discharge in cubic feet per second;

A = area in square feet;

c = coefficient according to circumstances;

H = head in feet.

APPENDIX III.



A few remarks are necessary, to make this work complete, on the coefficients to be used when the notches A, shown in Plate I., Diagrams A to I, become short level troughs or level shoots.

First, when the orifice becomes a short trough of about once and a half to twice its width the coefficient rises from $\cdot 615$ to $\cdot 667$, and even $\cdot 75$ under favourable conditions of entry; when the trough, if about 12 inches square, becomes 3 or 4 feet long, the coefficient to be used falls to $\cdot 5$, and to still less as the length of the trough increases; when, however, the trough is longer than 4 to 5 feet, the formula for *short* channels should be used as shown in Chapter VI.

The coefficients for orifices of the form shown in Plate I., Diagrams A to I, are therefore

| | | |
|--|---------|---------------------------|
| For thin plates | | $\cdot 615$ |
| For troughs $1\frac{1}{2}$ the width in length | | $\cdot 667$ to $\cdot 75$ |
| For troughs 12 inches square and 3 feet long | | $\cdot 5$ |

The formulæ remaining the same for each form, but the coefficient being altered as above.

TABLE I.—DISCHARGE OVER A WEIR TWELVE INCHES WIDE.

Coefficient 5.34. Rule:— $\frac{1}{2} \sqrt{\text{Depth in Feet,} \times 5.34 \times \text{Area in Feet}} =$
Discharge in Cubic Feet per Second.

| Depth in inches. | Cubic feet per second. | Gallons per hour. | Gallons per 24 hours. | Depth in inches. | Cubic feet per second. | Gallons per hour. | Gallons per 24 hours. |
|------------------------|---------------------------|----------------------|--------------------------|------------------------|---------------------------|----------------------|--------------------------|
| $\frac{1}{16}$ | •001338 | 30 | 721 | $2\frac{3}{8}$ | •313460 | 7030 | 168726 |
| $\frac{1}{8}$ | •003786 | 85 | 2038 | $2\frac{7}{8}$ | •325920 | 7309 | 175483 |
| $\frac{3}{16}$ | •006955 | 156 | 3744 | $2\frac{9}{8}$ | •338490 | 7591 | 182199 |
| $\frac{1}{4}$ | •010702 | 240 | 5760 | $2\frac{11}{8}$ | •351272 | 7878 | 189080 |
| $\frac{5}{16}$ | •014967 | 336 | 8056 | $2\frac{13}{8}$ | •364200 | 8168 | 196039 |
| $\frac{3}{8}$ | •019675 | 441 | 10590 | $2\frac{15}{8}$ | •377292 | 8462 | 203086 |
| $\frac{7}{16}$ | •024793 | 556 | 13345 | $2\frac{17}{8}$ | •390531 | 8759 | 210212 |
| $\frac{1}{2}$ | •030280 | 679 | 16292 | $2\frac{19}{8}$ | •403928 | 9059 | 217423 |
| $\frac{9}{16}$ | •036133 | 810 | 19449 | $2\frac{21}{8}$ | •417475 | 9363 | 224715 |
| $\frac{5}{8}$ | •042319 | 949 | 22779 | $2\frac{23}{8}$ | •431168 | 9670 | 232086 |
| $\frac{11}{16}$ | •048813 | 1094 | 26274 | 3 | •444972 | 9979 | 239516 |
| $\frac{3}{4}$ | •055638 | 1248 | 29948 | | | | |
| $\frac{7}{8}$ | •062734 | 1407 | 33768 | $3\frac{1}{8}$ | •458961 | 10293 | 247046 |
| $\frac{15}{16}$ | •070100 | 1572 | 37732 | $3\frac{1}{4}$ | •473087 | 10610 | 254649 |
| 1 | •077745 | 1744 | 41848 | $3\frac{3}{8}$ | •487338 | 10930 | 262320 |
| | •085635 | 1920 | 46094 | $3\frac{1}{2}$ | •501731 | 11253 | 270068 |
| | | | | $3\frac{5}{8}$ | •516311 | 11579 | 277915 |
| $1\frac{1}{16}$ | •093720 | 2104 | 50484 | $3\frac{7}{8}$ | •530997 | 11909 | 285821 |
| $1\frac{1}{8}$ | •102187 | 2292 | 55004 | $3\frac{9}{8}$ | •545820 | 12241 | 293800 |
| $1\frac{3}{16}$ | •110825 | 2485 | 59653 | $3\frac{11}{8}$ | •560744 | 12576 | 301832 |
| $1\frac{1}{4}$ | •119674 | 2684 | 64410 | $3\frac{13}{8}$ | •575833 | 12914 | 309955 |
| $1\frac{5}{16}$ | •128191 | 2888 | 69320 | $3\frac{15}{8}$ | •591068 | 13256 | 318155 |
| $1\frac{3}{8}$ | •137617 | 3086 | 74075 | $3\frac{17}{8}$ | •606415 | 13601 | 326416 |
| $1\frac{7}{16}$ | •147616 | 3310 | 79450 | $3\frac{19}{8}$ | •621906 | 13948 | 334755 |
| $1\frac{1}{2}$ | •157330 | 3528 | 84686 | $3\frac{21}{8}$ | •637463 | 14297 | 343128 |
| $1\frac{9}{16}$ | •167270 | 3751 | 90037 | $3\frac{23}{8}$ | •653242 | 14651 | 351622 |
| $1\frac{5}{8}$ | •177409 | 3979 | 95494 | $3\frac{25}{8}$ | •669108 | 15006 | 360161 |
| $1\frac{11}{16}$ | •187745 | 4210 | 101058 | 4 | •685108 | 15365 | 368774 |
| $1\frac{3}{4}$ | •198276 | 4447 | 106726 | | | | |
| $1\frac{7}{8}$ | •208996 | 4687 | 112497 | $4\frac{1}{8}$ | •701240 | 15727 | 377457 |
| $1\frac{15}{16}$ | •219879 | 4931 | 118355 | $4\frac{1}{4}$ | •717583 | 16094 | 386258 |
| 2 | •230965 | 5180 | 124322 | $4\frac{3}{8}$ | •733855 | 16459 | 395013 |
| | •242213 | 5432 | 130376 | $4\frac{1}{2}$ | •750353 | 16829 | 403894 |
| | | | | $4\frac{5}{8}$ | •766975 | 17201 | 412841 |
| $2\frac{1}{16}$ | •253663 | 5689 | 136536 | $4\frac{7}{8}$ | •783721 | 17577 | 421856 |
| $2\frac{1}{8}$ | •265277 | 5949 | 142791 | $4\frac{9}{8}$ | •800568 | 17955 | 430923 |
| $2\frac{3}{16}$ | •277073 | 6214 | 149140 | $4\frac{11}{8}$ | •817554 | 18336 | 440077 |
| $2\frac{1}{4}$ | •289021 | 6482 | 155566 | $4\frac{13}{8}$ | •834616 | 18719 | 449251 |
| $2\frac{5}{16}$ | •301164 | 6754 | 162108 | $4\frac{15}{8}$ | •851836 | 19104 | 458519 |

NOTE.—The head to be measured from still water and the weir to have a thin edge and clear overfall. This Table is not applicable where there is velocity of approach.

TABLE I.—DISCHARGE OVER A WEIR TWELVE INCHES WIDE—*continued.*

| Depth in inches. | Cubic feet per second. | Gallons per hour. | Gallons per 24 hours. | Depth in inches. | Cubic feet per second. | Gallons per hour. | Gallons per 24 hours. |
|------------------------|---------------------------|----------------------|--------------------------|------------------------|---------------------------|----------------------|--------------------------|
| $4\frac{1}{8}$ | ·869171 | 19493 | 467851 | $7\frac{1}{8}$ | 1·67187 | 37496 | 899919 |
| $4\frac{1}{4}$ | ·886598 | 19884 | 477231 | $7\frac{1}{4}$ | 1·69354 | 37983 | 911585 |
| $4\frac{1}{2}$ | ·904178 | 20278 | 486694 | $7\frac{1}{2}$ | 1·71530 | 38471 | 923301 |
| $4\frac{3}{4}$ | ·921847 | 20675 | 496204 | $7\frac{3}{4}$ | 1·73716 | 38961 | 935065 |
| $4\frac{7}{8}$ | ·939623 | 21074 | 505773 | $7\frac{7}{8}$ | 1·75911 | 39453 | 946879 |
| 5 | ·957528 | 21475 | 515411 | $7\frac{9}{8}$ | 1·78114 | 39947 | 958738 |
| $5\frac{1}{8}$ | ·975547 | 21879 | 525110 | $7\frac{5}{4}$ | 1·80328 | 40444 | 970654 |
| $5\frac{1}{4}$ | ·993569 | 22283 | 534811 | $7\frac{1}{2}$ | 1·82550 | 40942 | 982617 |
| $5\frac{1}{2}$ | 1·01180 | 22692 | 544627 | $7\frac{3}{4}$ | 1·84781 | 41444 | 994672 |
| $5\frac{3}{4}$ | 1·03018 | 23105 | 554519 | $7\frac{7}{8}$ | 1·87021 | 41945 | 1006680 |
| $5\frac{7}{8}$ | 1·04862 | 23518 | 564444 | $7\frac{9}{8}$ | 1·89272 | 42449 | 1018790 |
| $5\frac{1}{2}$ | 1·06718 | 23934 | 574434 | 8 | 1·91530 | 42956 | 1030950 |
| $5\frac{5}{8}$ | 1·08586 | 24354 | 584489 | | 1·93797 | 43464 | 1043150 |
| $5\frac{1}{2}$ | 1·10464 | 24774 | 594595 | $8\frac{1}{8}$ | 1·96072 | 43975 | 1055400 |
| $5\frac{3}{4}$ | 1·12343 | 25197 | 604739 | $8\frac{1}{4}$ | 1·98359 | 44488 | 1067710 |
| $5\frac{7}{8}$ | 1·14252 | 25622 | 614928 | $8\frac{1}{2}$ | 2·00650 | 45000 | 1080018 |
| $5\frac{1}{2}$ | 1·16159 | 26052 | 625245 | $8\frac{3}{4}$ | 2·02954 | 45518 | 1092442 |
| $5\frac{5}{8}$ | 1·18078 | 26483 | 635584 | $8\frac{7}{8}$ | 2·05264 | 46036 | 1104880 |
| $5\frac{1}{2}$ | 1·20009 | 26916 | 645975 | $8\frac{9}{8}$ | 2·07585 | 46557 | 1117368 |
| $5\frac{3}{4}$ | 1·21951 | 27351 | 656427 | $8\frac{5}{4}$ | 2·09914 | 47079 | 1129907 |
| $5\frac{7}{8}$ | 1·23904 | 27789 | 666940 | $8\frac{1}{2}$ | 2·12252 | 47604 | 1142494 |
| 6 | 1·25865 | 28229 | 677498 | $8\frac{3}{4}$ | 2·14598 | 48130 | 1155122 |
| $6\frac{1}{8}$ | 1·27838 | 28671 | 688116 | $8\frac{7}{8}$ | 2·16952 | 48683 | 1167791 |
| $6\frac{1}{4}$ | 1·29821 | 29116 | 698791 | $8\frac{5}{4}$ | 2·19313 | 49187 | 1180501 |
| $6\frac{3}{4}$ | 1·31813 | 29563 | 709511 | $8\frac{3}{2}$ | 2·21686 | 49719 | 1193273 |
| $6\frac{1}{2}$ | 1·33814 | 30012 | 720288 | $8\frac{1}{2}$ | 2·24066 | 50253 | 1206086 |
| $6\frac{5}{8}$ | 1·35828 | 30463 | 731122 | $8\frac{3}{4}$ | 2·26453 | 50789 | 1218934 |
| $6\frac{3}{4}$ | 1·37851 | 30917 | 742012 | $8\frac{7}{8}$ | 2·28823 | 51320 | 1231690 |
| $6\frac{7}{8}$ | 1·39884 | 31373 | 752960 | 9 | 2·31229 | 51860 | 1244640 |
| $6\frac{1}{2}$ | 1·41926 | 31831 | 763946 | $9\frac{1}{8}$ | 2·33644 | 52401 | 1257640 |
| $6\frac{5}{8}$ | 1·43967 | 32289 | 774936 | $9\frac{1}{4}$ | 2·36064 | 52944 | 1270665 |
| $6\frac{7}{8}$ | 1·46042 | 32754 | 786100 | $9\frac{3}{8}$ | 2·38485 | 53487 | 1283700 |
| $6\frac{1}{2}$ | 1·48113 | 33219 | 797251 | $9\frac{5}{8}$ | 2·40930 | 54036 | 1296856 |
| $6\frac{3}{4}$ | 1·50195 | 33686 | 808456 | $9\frac{7}{8}$ | 2·43374 | 54571 | 1309714 |
| $6\frac{5}{8}$ | 1·52279 | 34153 | 819674 | $9\frac{9}{8}$ | 2·45826 | 55134 | 1323212 |
| $6\frac{7}{8}$ | 1·54380 | 34624 | 830984 | $9\frac{1}{2}$ | 2·48293 | 55687 | 1336490 |
| $6\frac{1}{2}$ | 1·56489 | 35097 | 842340 | $9\frac{3}{4}$ | 2·50759 | 56240 | 1349764 |
| $6\frac{5}{8}$ | 1·58610 | 35573 | 853754 | $9\frac{5}{4}$ | 2·53239 | 56796 | 1363113 |
| 7 | | | | $9\frac{7}{8}$ | 2·55751 | 57359 | 1376636 |
| $7\frac{1}{8}$ | 1·60740 | 36051 | 865219 | $9\frac{9}{8}$ | 2·58223 | 57914 | 1389932 |
| $7\frac{1}{4}$ | 1·62879 | 36530 | 876735 | $9\frac{5}{2}$ | 2·60727 | 58475 | 1403419 |
| $7\frac{3}{8}$ | 1·65029 | 37012 | 888302 | $9\frac{1}{2}$ | 2·63237 | 59068 | 1416930 |

TABLE I.—DISCHARGE OVER A WEIR TWELVE INCHES WIDE—*continued*.

| Depth in inches. | Cubic feet per second. | Gallons per hour. | Gallons per 24 hours. | Depth in inches. | Cubic feet per second. | Gallons per hour. | Gallons per 24 hours. |
|------------------------|---------------------------|----------------------|--------------------------|------------------------|---------------------------|----------------------|--------------------------|
| 9 $\frac{7}{8}$ | 2·65758 | 59604 | 1430500 | 13 $\frac{3}{4}$ | 4·36667 | 97933 | 2350400 |
| 9 $\frac{1}{2}$ | 2·68285 | 60170 | 1444103 | 14 | 4·48608 | 100613 | 2414720 |
| 10 | 2·70815 | 60738 | 1457722 | 14 $\frac{1}{2}$ | 4·60679 | 103321 | 2479706 |
| 10 $\frac{1}{8}$ | 2·73364 | 61310 | 1471440 | 14 $\frac{1}{4}$ | 4·72876 | 106056 | 2545360 |
| 10 $\frac{1}{4}$ | 2·75906 | 61880 | 1485124 | 14 $\frac{3}{4}$ | 4·85137 | 108805 | 2611338 |
| 10 $\frac{3}{8}$ | 2·78467 | 62454 | 1498906 | 15 | 4·97528 | 111585 | 2678052 |
| 10 $\frac{1}{2}$ | 2·81033 | 63030 | 1512720 | 15 $\frac{1}{2}$ | 5·10024 | 114388 | 2745316 |
| 10 $\frac{3}{4}$ | 2·83610 | 63607 | 1526591 | 15 $\frac{3}{4}$ | 5·22593 | 117207 | 2812972 |
| 10 $\frac{7}{8}$ | 2·86192 | 64187 | 1540493 | 16 | 5·35300 | 120057 | 2881370 |
| 10 $\frac{1}{2}$ | 2·88783 | 64768 | 1554437 | 16 $\frac{1}{2}$ | 5·48108 | 122929 | 2950313 |
| 10 $\frac{3}{4}$ | 2·91380 | 65350 | 1568416 | 16 $\frac{3}{4}$ | 5·60983 | 125809 | 3019614 |
| 10 $\frac{7}{8}$ | 2·93983 | 65934 | 1582427 | 17 | 5·73978 | 128731 | 3089562 |
| 10 $\frac{1}{2}$ | 2·96596 | 66520 | 1596492 | 17 $\frac{1}{2}$ | 5·87099 | 131674 | 3160190 |
| 10 $\frac{3}{4}$ | 2·99218 | 67108 | 1610607 | 17 $\frac{3}{4}$ | 6·00264 | 134627 | 3231053 |
| 10 $\frac{7}{8}$ | 3·01847 | 67698 | 1624756 | 18 | 6·13563 | 137609 | 3302635 |
| 10 $\frac{1}{2}$ | 3·04485 | 68289 | 1638950 | 18 $\frac{1}{2}$ | 6·26967 | 140615 | 3374780 |
| 10 $\frac{3}{4}$ | 3·07126 | 68882 | 1653170 | 18 $\frac{3}{4}$ | 6·40427 | 143640 | 3447240 |
| 10 $\frac{7}{8}$ | 3·09778 | 69476 | 1667445 | 19 | 6·54001 | 146679 | 3520301 |
| 11 | 3·12439 | 70073 | 1681770 | 19 $\frac{1}{2}$ | 6·67692 | 149750 | 3594000 |
| 11 $\frac{1}{8}$ | 3·15071 | 70664 | 1695939 | 19 $\frac{3}{4}$ | 6·81408 | 152826 | 3667825 |
| 11 $\frac{1}{4}$ | 3·17774 | 71270 | 1710487 | 20 | 6·95318 | 155945 | 3742701 |
| 11 $\frac{1}{2}$ | 3·20456 | 71873 | 1724960 | 20 $\frac{1}{2}$ | 7·09285 | 159078 | 3817880 |
| 11 $\frac{3}{8}$ | 3·23151 | 72476 | 1739430 | 20 $\frac{3}{4}$ | 7·23297 | 162221 | 3893304 |
| 11 $\frac{1}{2}$ | 3·25845 | 73080 | 1753931 | 21 | 7·37449 | 165395 | 3969480 |
| 11 $\frac{3}{4}$ | 3·28552 | 73687 | 1768502 | 21 $\frac{1}{2}$ | 7·51696 | 168590 | 4046170 |
| 11 $\frac{7}{8}$ | 3·31263 | 74295 | 1783100 | 21 $\frac{3}{4}$ | 7·65985 | 171795 | 4123080 |
| 11 $\frac{1}{2}$ | 3·33980 | 74905 | 1797722 | 22 | 7·80392 | 175026 | 4200633 |
| 11 $\frac{3}{4}$ | 3·36703 | 75515 | 1812380 | 22 $\frac{1}{2}$ | 7·94911 | 178282 | 4278782 |
| 11 $\frac{7}{8}$ | 3·39443 | 76130 | 1827125 | 22 $\frac{3}{4}$ | 8·09464 | 181546 | 4357120 |
| 11 $\frac{1}{2}$ | 3·42180 | 76744 | 1841860 | 23 | 8·24154 | 184841 | 4436190 |
| 11 $\frac{3}{4}$ | 3·44931 | 77360 | 1856661 | 23 $\frac{1}{2}$ | 8·38933 | 188155 | 4515740 |
| 11 $\frac{7}{8}$ | 3·47686 | 77978 | 1871490 | 23 $\frac{3}{4}$ | 8·53762 | 191481 | 4595562 |
| 11 $\frac{1}{2}$ | 3·50451 | 78599 | 1886380 | 24 | 8·68687 | 194829 | 4675901 |
| 11 $\frac{3}{4}$ | 3·53220 | 79220 | 1901287 | 24 $\frac{1}{2}$ | 8·83736 | 198204 | 4756904 |
| 12 | 3·55996 | 79842 | 1916230 | 24 $\frac{3}{4}$ | 8·98812 | 201585 | 4838051 |
| 12 $\frac{1}{8}$ | 3·67195 | 82354 | 1976500 | 25 | 9·14001 | 204992 | 4919810 |
| 12 $\frac{1}{4}$ | 3·78481 | 84886 | 2037260 | 25 $\frac{1}{2}$ | 9·29313 | 208426 | 5002230 |
| 12 $\frac{1}{2}$ | 3·89889 | 87444 | 2098661 | 25 $\frac{3}{4}$ | 9·44643 | 211865 | 5084770 |
| 13 | 4·01431 | 90033 | 2160790 | 26 | 9·60091 | 215329 | 5167900 |
| 13 $\frac{1}{8}$ | 4·13042 | 92637 | 2223290 | 26 $\frac{1}{2}$ | 9·75635 | 218815 | 5251570 |
| 13 $\frac{1}{4}$ | 4·24790 | 95272 | 2286535 | 26 $\frac{3}{4}$ | 9·91218 | 222310 | 5335450 |
| | | | | 27 | 10·0694 | 225834 | 5420031 |

TABLE II.—SHOWING COEFFICIENTS OF DISCHARGE FROM SQUARE AND DIFFERENTLY PROPORTIONED RECTANGULAR LATERAL ORIFICES IN THIN VERTICAL PLATES FROM PONCELOT AND LESBROS. THE ORIFICES ARE ALL 7.874 INCHES WIDE.

| Heads of Water measured to the upper sides of the orifices, in inches. | Ratio of the head to the length of the orifice. | Square orifice 7.874" X 7.874" Ratio of sides 1 to 1. Head taken back from the orifice. | Rectangular orifice 7.874" X 3.937". Ratio of sides 2 to 1. Head taken back from the orifice. | Rectangular orifice 7.874" X 1.968". Ratio 4 to 1. Head taken back from the orifice. | Rectangular orifice 7.874" X 1.181". Ratio 7 to 1. Head taken back from the orifice. | Rectangular orifice 7.874" X 0.787". Ratio 10 to 1. Head taken back from the orifice. | Rectangular orifice 7.874" X 0.394". Ratio 20 to 1. Head taken back from the orifice. | REMARKS, &c. |
|--|---|---|---|--|--|---|---|--------------|
| 0 | .. | .. | .. | .. | .. | .. | .. | |
| 0.197 | .025 | .. | .. | .607 | .. | .. | .705 | |
| 0.394 | .050 | .. | .. | .612 | .630 | .660 | .701 | |
| 0.591 | .075 | .. | .593 | .615 | .632 | .660 | .697 | |
| 0.787 | .100 | .572 | .596 | .620 | .638 | .659 | .694 | |
| 1.181 | .150 | .578 | .600 | .623 | .640 | .658 | .688 | |
| 1.575 | .200 | .582 | .603 | .625 | .640 | .657 | .683 | |
| 1.969 | .250 | .585 | .605 | .627 | .640 | .657 | .679 | |
| 2.362 | .300 | .587 | .607 | .628 | .639 | .656 | .676 | |
| 2.756 | .350 | .588 | .609 | .629 | .638 | .656 | .673 | |
| 3.150 | .400 | .589 | .610 | .629 | .638 | .655 | .670 | |
| 3.545 | .450 | .591 | .610 | .629 | .637 | | .668 | |

| | | | | | | | |
|---------|--------|------|------|------|------|------|------|
| 3.987 | .500 | .592 | .611 | .630 | .637 | .654 | .666 |
| 4.724 | .600 | .593 | .612 | .630 | .636 | .653 | .663 |
| 5.512 | .700 | .595 | .613 | .630 | .635 | .651 | .660 |
| 6.299 | .800 | .596 | .614 | .631 | .634 | .650 | .658 |
| 7.087 | .900 | .597 | .615 | .630 | .633 | .649 | .657 |
| 7.874 | 1.000 | .598 | .615 | .630 | .633 | .648 | .655 |
| 9.843 | 1.250 | .599 | .616 | .630 | .632 | .646 | .653 |
| 11.811 | 1.500 | .600 | .616 | .629 | .632 | .644 | .650 |
| 15.748 | 2.000 | .602 | .617 | .628 | .631 | .642 | .647 |
| 19.685 | 2.500 | .603 | .617 | .628 | .630 | .640 | .644 |
| 23.622 | 3.000 | .604 | .617 | .627 | .630 | .638 | .642 |
| 27.560 | 3.500 | .604 | .616 | .627 | .629 | .637 | .640 |
| 31.497 | 4.000 | .605 | .616 | .627 | .629 | .636 | .637 |
| 35.434 | 4.500 | .605 | .615 | .626 | .628 | .634 | .635 |
| 39.371 | 5.000 | .605 | .615 | .626 | .628 | .633 | .632 |
| 43.307 | 5.500 | .604 | .614 | .625 | .627 | .631 | .629 |
| 47.245 | 6.000 | .604 | .614 | .624 | .626 | .628 | .626 |
| 51.182 | 6.500 | .603 | .613 | .622 | .624 | .625 | .622 |
| 55.119 | 7.000 | .603 | .612 | .621 | .622 | .622 | .618 |
| 59.056 | 7.500 | .602 | .611 | .620 | .620 | .619 | .615 |
| 62.993 | 8.000 | .602 | .611 | .618 | .618 | .617 | .613 |
| 66.930 | 8.500 | .602 | .610 | .617 | .616 | .615 | .612 |
| 70.867 | 9.000 | .601 | .609 | .615 | .615 | .614 | .612 |
| 74.805 | 9.500 | .601 | .608 | .614 | .613 | .612 | .611 |
| 78.742 | 10.000 | .601 | .607 | .613 | .612 | .612 | .611 |
| 118.112 | 15.000 | .601 | .603 | .606 | .608 | .610 | .609 |

TABLE III.

The following table exhibits the results of experiments made on the canal at Languedoc by Lespinasse, on a sluice gate of a breadth of 4.265 feet. The woodwork which surrounded this orifice was 0.886 foot thick, and even 1.772 foot thick on the lower edge, also when the gate was raised only slightly the contraction ceased on all four sides, and the coefficient increased considerably; for example, the gate being only raised 0.394 foot, had for a coefficient 0.803,* while with 1.509 foot opening a coefficient of only 0.641 was obtained.

| Openings. | | Head on the centre of orifice. | Discharge in one second, cube feet. | Coefficient. |
|---------------------|---------------|-----------------------------------|--|--------------|
| Area, sq. feet. | Height, feet. | | | |
| 7.745 | 1.805 | 14.554 | 145.292 | .613 |
| 6.992 | 1.640 | 6.631 | 92.635 | .641 |
| 6.992 | 1.640 | 6.247 | 88.221 | .629 |
| 6.466 | 1.509 | 12.878 | 138.937 | .641 |
| 6.723 | 1.575 | 13.586 | 128.764 | .647 |
| 6.723 | 1.575 | 6.394 | 83.948 | .616 |
| 6.723 | 1.575 | 6.217 | 79.857 | .594 |
| 6.717 | 1.575 | 6.480 | 85.219 | .621 |
| Mean coefficient .. | | | | .625 |

* This was probably due to the orifice becoming a rectangular tube when slightly raised.

TABLE IV.—SHOWING THE COEFFICIENTS OF DISCHARGE FOR *Short Tubes with Square Edges* NEXT RESERVOIR.

| Name of Observer. | Tube. | | Head, feet. | Coefficient. | REMARKS. |
|-------------------|-----------------|---------------|---------------------|--------------|----------|
| | Diameter, feet. | Length, feet. | | | |
| Castel .. | .0509 | .1312 | .6562 | .827 | |
| " .. | .0509 | .1312 | 1.5749 | .829 | |
| " .. | .0509 | .1312 | 3.2478 | .829 | |
| " .. | .0509 | .1312 | 6.5620 | .829 | |
| " .. | .0509 | .1312 | 9.9414 | .830 | |
| Eytelwein .. | .0853 | .2559 | 2.3623 | .821 | |
| Bossut .. | .0886 | .0341 | 12.6318 | .804 | |
| " .. | .0886 | .1772 | 12.6975 | .804 | |
| " .. | .0886 | .3543 | 12.8615 | .804 | |
| Venturi.. | .1345 | .4200 | 2.8873 | .822 | |
| Michelotti .. | .2658 | .7087 | 7.1526 | .815 | |
| " .. | Square .2658 | .7087 | 12.4678 | .803 | |
| " .. | .2658 | .7087 | 22.0155 | .803 | |
| | | | Mean coefficient .. | .817 | |

TABLE V.—COEFFICIENTS OF DISCHARGE FOR *Circular* ORIFICES IN THIN PLATES.

| Name of Observer. | Diameter in inches. | Head in feet. | Coefficient. | Ratio of head to diameter. | REMARKS. |
|----------------------------------|---------------------|---------------|--------------|----------------------------|----------|
| Mariotti .. | 0.268 | 5.873 | 0.692 | 263.000 | |
| " .. | 0.268 | 25.920 | 0.692 | 1160.600 | |
| Castel .. | 0.394 | 2.133 | 0.673 | 64.964 | |
| " .. | 0.394 | 1.017 | 0.654 | 30.974 | |
| " .. | 0.590 | 0.453 | 0.632 | 9.213 | |
| " .. | 0.590 | 0.984 | 0.617 | 20.015 | |
| Eytelwein .. | 1.027 | 2.372 | 0.618 | 27.715 | |
| Bossut .. | 1.067 | 4.265 | 0.619 | 47.965 | |
| Michelotti .. | 1.067 | 7.317 | 0.618 | 92.290 | |
| Castel .. | 1.181 | 0.223 | 0.629 | 1.477 | |
| Venturi.. | 1.614 | 2.887 | 0.622 | 21.464 | |
| Bossut .. | 2.126 | 12.500 | 0.618 | 70.555 | |
| Michelotti .. | 2.126 | 7.218 | 0.607 | 40.741 | |
| " .. | 3.189 | 7.349 | 0.613 | 27.650 | |
| " .. | 3.189 | 12.500 | 0.612 | 47. | |
| " .. | 3.189 | 22.179 | 0.597? | 83. | |
| " .. | 6.378 | 6.923 | 0.619 | 13. | |
| " .. | 6.378 | 12.008 | 0.619 | 22. | |
| Mean coefficient excluding 0.597 | | .. | 0.632 | | |

TABLE VI.—COEFFICIENTS OF DISCHARGE FOR SQUARE ORIFICES IN THIN PLATES.


| Name of Observer. | Side of square, in inches. | Head, in feet. | Coefficient. | Ratio of head to length. | REMARKS. |
|---------------------|-------------------------------|----------------|--------------|-----------------------------|----------|
| Castel | 0.394 | 0.164 | 0.655 | 5 | |
| Bossut | 1.063 | 12.500 | 0.616 | 141 | |
| Michelotti .. | 1.063 | 12.500 | 0.607 | 141 | |
| " | 1.063 | 22.409 | 0.606 | 253 | |
| Bossut | 2.126 | 12.500 | 0.618 | 70 | |
| Michelotti .. | 2.126 | 7.849 | 0.603 | 41 | |
| " | 2.126 | 12.566 | 0.603 | 70 | |
| " | 2.126 | 22.245 | 0.602 | 125 | |
| " | 3.228 | 7.415 | 0.616 | 28 | |
| " | 3.189 | 12.566 | 0.619 | 47 | |
| " | 3.189 | 22.376 | 0.616 | 84 | |
| Mean coefficient .. | | | | .. | |

TABLE VII.—SHOWING THE DISCHARGES THROUGH A SHORT PIPE OF TWO DIAMETERS COMING FROM A BOX, AS SHOWN ON DIAGRAM 1, PLATE VIII., WITH A HEAD ON THE *Centre* OF THE PIPE * OF ONE (1) FOOT.

| Diameter in inches. | Discharge in gallons per minute. | Discharge in gallons in 8 hours. | REMARKS. |
|---------------------|----------------------------------|----------------------------------|---|
| $\frac{1}{2}$ | 3.25 | 1,560 | The head assumed to give the discharge shown is in all cases <i>one foot</i> in this table. |
| 1 | 13.00 | 6,240 | |
| $1\frac{1}{2}$ | 29.25 | 14,040 | The discharge for any other head may be found by the rule that the discharge is proportional to the square root of the head. |
| 2 | 52.00 | 24,960 | |
| $2\frac{1}{2}$ | 81.25 | 39,000 | A sluice head in Victoria is equal to about 200,000 gallons in 24 hours, therefore a 4-inch pipe in a box of the description shown in Plate VIII. should have a head of 0.668 feet or $8\frac{1}{8}$ inches over the <i>centre</i> of the pipe to give one "sluice head." |
| 3 | 117.00 | 56,160 | |
| $3\frac{1}{2}$ | 159.25 | 76,440 | The head should be measured to still water—or an addition made for velocity of approach. |
| 4 | 208.00 | 99,840 | |
| $4\frac{1}{2}$ | 263.25 | 126,360 | |
| 5 | 325.00 | 156,000 | |
| $5\frac{1}{2}$ | 393.25 | 188,760 | |
| 6 | 468.00 | 224,640 | |
| $6\frac{1}{2}$ | 549.25 | 263,640 | |
| 7 | 637.00 | 305,760 | |
| $7\frac{1}{2}$ | 731.25 | 351,000 | |
| 8 | 832.00 | 399,360 | |
| $8\frac{1}{2}$ | 939.25 | 450,840 | |
| 9 | 1053.00 | 505,440 | |
| $9\frac{1}{2}$ | 1173.25 | 563,160 | |
| 10 | 1300.00 | 624,000 | |
| $10\frac{1}{2}$ | 1433.25 | 687,960 | |
| 11 | 1573.00 | 755,040 | |
| $11\frac{1}{2}$ | 1719.25 | 825,240 | |
| 12 | 1872.00 | 898,560 | |

* This pipe is supposed to be horizontal.









1. The first part of the document is a list of names, followed by a list of dates, and then a list of locations. The names are listed in alphabetical order, and the dates are listed in chronological order. The locations are listed in alphabetical order.

2. The second part of the document is a list of names, followed by a list of dates, and then a list of locations. The names are listed in alphabetical order, and the dates are listed in chronological order. The locations are listed in alphabetical order.

3. The third part of the document is a list of names, followed by a list of dates, and then a list of locations. The names are listed in alphabetical order, and the dates are listed in chronological order. The locations are listed in alphabetical order.

4. The fourth part of the document is a list of names, followed by a list of dates, and then a list of locations. The names are listed in alphabetical order, and the dates are listed in chronological order. The locations are listed in alphabetical order.

5. The fifth part of the document is a list of names, followed by a list of dates, and then a list of locations. The names are listed in alphabetical order, and the dates are listed in chronological order. The locations are listed in alphabetical order.

6. The sixth part of the document is a list of names, followed by a list of dates, and then a list of locations. The names are listed in alphabetical order, and the dates are listed in chronological order. The locations are listed in alphabetical order.

7. The seventh part of the document is a list of names, followed by a list of dates, and then a list of locations. The names are listed in alphabetical order, and the dates are listed in chronological order. The locations are listed in alphabetical order.


8. The eighth part of the document is a list of names, followed by a list of dates, and then a list of locations. The names are listed in alphabetical order, and the dates are listed in chronological order. The locations are listed in alphabetical order.


9. The ninth part of the document is a list of names, followed by a list of dates, and then a list of locations. The names are listed in alphabetical order, and the dates are listed in chronological order. The locations are listed in alphabetical order.

10. The tenth part of the document is a list of names, followed by a list of dates, and then a list of locations. The names are listed in alphabetical order, and the dates are listed in chronological order. The locations are listed in alphabetical order.

1. The first part of the document is a list of names and titles, including "The Hon. Mr. Justice" and "The Hon. Mr. Justice".

1























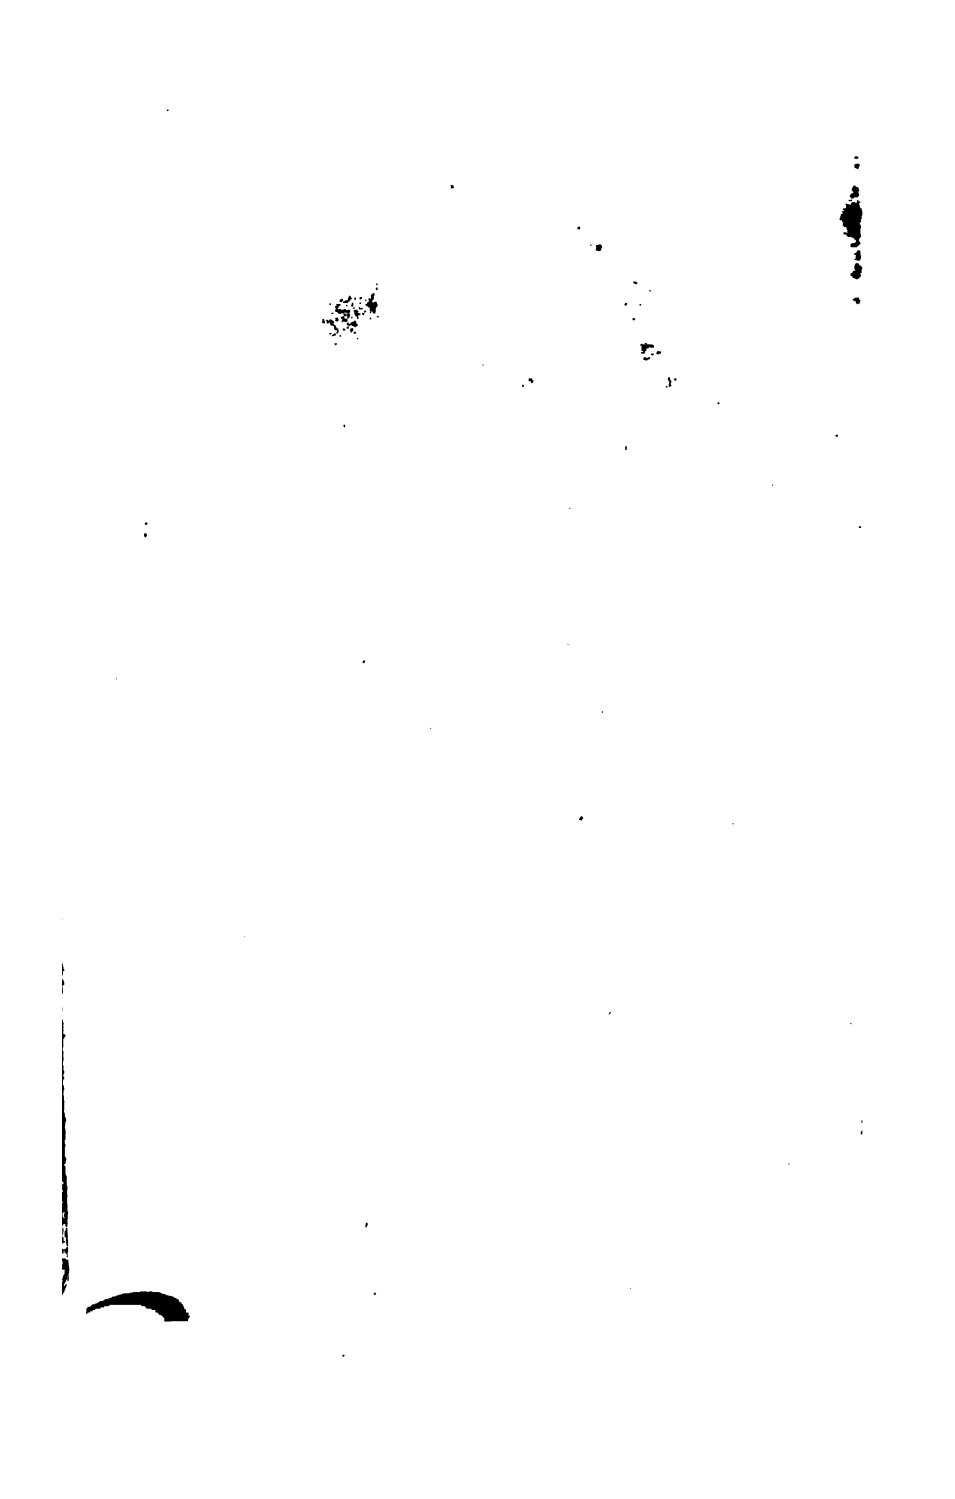

BOOKS RELATING
TO
APPLIED SCIENCE,

PUBLISHED BY

E. & F. N. SPON,
LONDON: 16, CHARING CROSS.
NEW YORK: 446, BROOME STREET.

A Pocket-Book for Chemists, Chemical Manufacturers, Metallurgists, Dyers, Distillers, Brewers, Sugar Refiners, Photographers, Students, etc., etc. By THOMAS BAYLEY, Assoc. R.C. Sc. Ireland, Analytical and Consulting Chemist, Demonstrator of Practical Chemistry, Analysis, and Assaying, in the Mining School, Bristol. Second edition, royal 32mo, roan, gilt edges, 5s.

SYNOPSIS OF CONTENTS:

Atomic Weights and Factors—Useful Data—Chemical Calculations—Rules for Indirect Analysis—Weights and Measures—Thermometers and Barometers—Chemical Physics—Boiling Points, etc.—Solubility of Substances—Methods of Obtaining Specific Gravity—Conversion of Hydrometers—Strength of Solutions by Specific Gravity—Analysis—Gas Analysis—Water Analysis—Qualitative Analysis and Reactions—Volumetric Analysis—Manipulation—Mineralogy—Assaying—Alcohol—Beer—Sugar—Miscellaneous Technological matter relating to Potash, Soda, Sulphuric Acid, Chlorine, Tar Products, Petroleum, Milk, Tallow, Photography, Prices, Wages, etc., etc.

Algebra Self-Taught. By W. P. HIGGS, M.A., D.Sc., LL.D., Assoc. Inst. C.E., Author of 'A Handbook of the Differential Calculus,' etc. Second edition, crown 8vo, cloth, 2s. 6d.

CONTENTS:

Symbols and the Signs of Operation—The Equation and the Unknown Quantity—Positive and Negative Quantities—Multiplication—Involution—Exponents—Negative Exponents—Roots, and the Use of Exponents as Logarithms—Logarithms—Tables of Logarithms and Proportionate Parts—Transformation of System of Logarithms—Common Uses of Common Logarithms—Compound Multiplication and the Binomial Theorem—Division, Fractions and Ratio—Continued Proportion—The Series and the Summation of the Series—Limit of Series—Square and Cube Roots—Equations—List of Formulae, etc.

On Designing Belt Gearing. By E. J. COWLING WELCH, Mem. Inst. Mech. Engineers, Author of 'Designing Valve Gearing.' Fcap. 8vo, sewed, 6d.

A Handbook of Formulæ, Tables, and Memoranda, for Architectural Surveyors and others engaged in Building. By J. T. HURST, C.E. Twelfth edition, royal 32mo, roan, 5s.

CONTAINING :

Formulæ and Tables for the Strength of Materials, Roofs, Water Supply, Drainage, Gas, and other matters useful to Architects and Builders—Information connected with Sanitary Engineering—Memoranda on the several Trades used in Building, including a Description of Materials and Analyses for Prices of Builders' Work—The Practice of Builders' Measurement—Mensuration and the Division of Land—Tables of the Weights of Iron and other Building Materials—Constants of Labour—Valuation of Property—Summary of the Practice in Dilapidations—Scale of Professional Charges for Architects and Surveyors—Tables of English and French Weights and Measures.

"It is no disparagement to the many excellent publications we refer to, to say that in our opinion this little pocket-book of Hurst's is the very best of them all, without any exception. It would be useless to attempt a recapitulation of the contents, for it appears to contain almost *everything* that anyone connected with building could require, and, best of all, made up in a compact form for carrying in the pocket, measuring only 5 in. by 3 in., and about $\frac{1}{2}$ in. thick, in a limp cover. We congratulate the author on the success of his laborious and practically compiled little book, which has received unqualified and deserved praise from every professional person to whom we have shown it."—*The Dublin Builder*.

Quantity Surveying. By J. LEANING. With 42 illustrations, crown 8vo, cloth, 9s.

CONTENTS :

A complete Explanation of the London Practice.
General Instructions.
Order of Taking Off.
Modes of Measurement of the various Trades.
Use and Waste.
Ventilation and Warming.
Credits, with various Examples of Treatment.
Abbreviations.
Squaring the Dimensions
Abstracting, with Examples in illustration of each Trade.
Billing.
Examples of Preambles to each Trade.
Form for a Bill of Quantities.
Do. Bill of Credits.
Do. Bill for Alternative Estimate.
Restorations and Repairs, and Form of Bill.
Variations before Acceptance of Tender.
Errors in a Builder's Estimate.

Schedule of Prices.
Form of Schedule of Prices.
Analysis of Schedule of Prices.
Adjustment of Accounts.
Form of a Bill of Variations.
Remarks on Specifications.
Prices and Valuation of Work, with Examples and Remarks upon each Trade.
The Law as it affects Quantity Surveyors, with Law Reports.
Taking Off after the Old Method.
Northern Practice.
The General Statement of the Methods recommended by the Manchester Society of Architects for taking Quantities.
Examples of Collections.
Examples of "Taking Off" in each Trade.
Remarks on the Past and Present Methods of Estimating.

The Principles of Graphic Statics. By GEORGE SYDENHAM CLARKE, Lieut. Royal Engineers. With 112 illustrations. 4to, cloth, 12s. 6d.

Spons' Builders' Pocket-Book of Prices and Memoranda. Edited by W. YOUNG, Architect. Royal 32mo, roan, 4s. 6d.; or cloth, red edges, 3s. 6d. *Published annually.* Eighth edition. *Now ready.*

Long-Span Railway Bridges, comprising Investigations of the Comparative Theoretical and Practical Advantages of the various adopted or proposed Type Systems of Construction, with numerous Formulæ and Tables giving the weight of Iron or Steel required in Bridges from 300 feet to the limiting Spans; to which are added similar Investigations and Tables relating to Short-span Railway Bridges. Second and revised edition. By B. BAKER, Assoc. Inst. C.E. *Plates*, crown 8vo, cloth, 5s.

Elementary Theory and Calculation of Iron Bridges and Roofs. By AUGUST RITTER, Ph.D., Professor at the Polytechnic School at Aix-la-Chapelle. Translated from the third German edition, by H. R. SANKEY, Capt. R.E. With 500 *illustrations*, 8vo, cloth, 15s.

The Builder's Clerk: a Guide to the Management of a Builder's Business. By THOMAS BALES. Fcap. 8vo, cloth, 1s. 6d.

The Elementary Principles of Carpentry. By THOMAS TREDGOLD. Revised from the original edition, and partly re-written, by JOHN THOMAS HURST. Contained in 517 pages of letterpress, and *illustrated with 48 plates and 150 wood engravings.* Third edition, crown 8vo, cloth, 18s.

Section I. On the Equality and Distribution of Forces—Section II. Resistance of Timber—Section III. Construction of Floors—Section IV. Construction of Roofs—Section V. Construction of Domes and Cupolas—Section VI. Construction of Partitions—Section VII. Scaffolds, Staging, and Gantries—Section VIII. Construction of Centres for Bridges—Section IX. Cofferdams, Shoring, and Strutting—Section X. Wooden Bridges and Viaducts—Section XI. Joints, Straps, and other Fastenings—Section XII. Timber.

Engineering Notes. By FRANK ROBERTSON, Fellow Roy. Astron. Soc., late first Lieut. R.E., and Civil Engineer Public Works Department in India. 8vo, cloth, 12s. 6d.

The object of this work is to supply an exhaustive digest of all that is known on each subject, so far as is necessary and sufficient for an Engineer in practice, especially in India.

The Electric Light in its Practical Application. By PAGET HIGGS, LL.D., D.Sc., Telford Prizeman, and Associate Member of the Institution of Civil Engineers. With 94 *illustrations*, 240 pages. Demy 8vo, cloth, 9s.

CONTENTS :

Introductory—Lamps or Burners Employing the Voltaic Arc—Electric "Candles" and Candle Lamps—Lighting by Incandescence—Magneto and Dynamo-electric Machines—Mechanical Efficiency of Electric Light Machines—Simple Mathematical Considerations Concerning Electric Lighting—Electric Regulators—Commercial Aspect of Electric Lighting—Division of the Electric Light—Maritime and Military Aspects—Various Applications of the Electric Light—Electric Carbons.

Progressive Lessons in Applied Science. By EDWARD SANG, F.R.S.E. Crown 8vo, cloth, each Part, 3s.

Part 1. Geometry on Paper—Part 2. Solidity, Weight, and Pressure—Part 3. Trigonometry, Vision, and Surveying Instruments.

A Practical Treatise on Coal Mining. By GEORGE G. ANDRÉ, F.G.S., Assoc. Inst. C.E., Member of the Society of Engineers. With 82 lithographic plates. 2 vols., royal 4to, cloth, 3*l* 12s.

CONTENTS:

I. Practical Geology—II. Coal, its Mode of Occurrence, Composition, and Varieties—III. Searching for Coal—IV. Shaft-sinking—V. Driving of Levels, or Narrow Work—VI. Systems of Working—VII. Getting the Coal—VIII. Haulage—IX. Winding—X. Drainage—XI. Ventilation—XII. Incidental Operations—XIII. Surface Work—XIV. Management and Accounts—XV. Characteristics of the Coal Fields of Great Britain and America.

The Electric Transmission of Power, its Present Position and Advantages. By PAGET HIGGS, LL.D., D.Sc., Telford Prizeman, and Associate Member of the Institution of Civil Engineers. With numerous illustrations. Crown 8vo, cloth, 3s.

CONTENTS:

Dynamo-electric Machines—The Gramme Machine—The Brush Machine—The Wallace-Farmer and Siemens Machines—Efficiency of Dynamo-electric Machines—Practicability of the Transmission of Power by Electricity—Efficiency of Coupled Machines—Comparative Efficiency of Various Machines—Other Theoretical Considerations—Conclusions.

Spons' Information for Colonial Engineers. Edited by J. T. HURST. Demy 8vo, sewed.

No. 1, Ceylon. By ABRAHAM DEANE, C.E. 2s. 6*d*.

CONTENTS:

Introductory Remarks—Natural Productions—Architecture and Engineering—Topography, Trade, and Natural History—Principal Stations—Weights and Measures, etc., etc.

No. 2. Southern Africa, including the Cape Colony, Natal, and the Dutch Republics. By HENRY HALL, F.R.G.S., F.R.C.I. With Map. 3s. 6*d*.

CONTENTS:

General Description of South Africa—Physical Geography with reference to Engineering Operations—Notes on Labour and Material in Cape Colony—Geological Notes on Rock Formation in South Africa—Engineering Instruments for Use in South Africa—Principal Public Works in Cape Colony: Railways, Mountain Roads and Passes, Harbour Works, Bridges, Gas Works, Irrigation and Water Supply, Lighthouses, Drainage and Sanitary Engineering, Public Buildings, Mines—Table of Woods in South Africa—Animals used for Draught Purposes—Statistical Notes—Table of Distances—Rates of Carriage, etc.

No. 3. India. By F. C. DANVERS, Assoc. Inst. C.E. With Map. 4s. 6*d*.

CONTENTS:

Physical Geography of India—Building Materials—Roads—Railways—Bridges—Irrigation—River Works—Harbours—Lighthouse Buildings—Native Labour—The Principal Trees of India—Money—Weights and Measures—Glossary of Indian Terms, etc.

A Practical Treatise on Casting and Founding, including descriptions of the modern machinery employed in the art. By N. E. SPRETSON, Engineer. With 82 plates drawn to scale, 412 pp. Demy 8vo, cloth, 18s.

The Clerk of Works: a Vade-Mecum for all engaged in the Superintendence of Building Operations. By G. G. HOSKINS, F.R.I.B.A. Fcap. 8vo, cloth, 1s. 6d.

Coffee Planting in Southern India and Ceylon. By E. C. P. HULL. Crown 8vo, cloth, 9s.

Tropical Agriculture; or, the Culture, Preparation, Commerce, and Consumption of the Principal Products of the Vegetable Kingdom, as furnishing Food, Clothing, Medicine, etc., and in their relation to the Arts and Manufactures; forming a practical treatise and Handbook of Reference for the Colonist, Manufacturer, Merchant, and Consumer, on the Cultivation, Preparation for Shipment, and Commercial Value, etc., of the various Substances obtained from Trees and Plants entering into the Husbandry of Tropical and Sub-Tropical Regions. By P. L. SIMMONDS. Second edition, revised and improved, 515 pages, 8vo, cloth, 1l. 1s.

Steel, its History, Manufacture, and Uses. By J. S. JEANS, Secretary of the Iron and Steel Institute. 860 pages and 24 plates. 8vo, cloth, 36s.

Section I., HISTORY OF STEEL: Chap. 1. History of Steel—2. Early History in England—3. Progress of Invention—4. History of Bessemer Process—5. Siemens-Martin Process—6. Other Steel-making Processes—7. Steel in America—8. Germany—9. France—10. Austria—11. Russia—12. Sweden—13. Other Countries. Section II., MANUFACTURE OF STEEL: Chap. 14. Cementation and other Methods—15. Manufacture by Bessemer Process—16. Siemens-Martin Process—17. Other Methods. Section III., CHEMICAL AND PHYSICAL PROPERTIES OF STEEL: Chap. 18. Phosphorus in Steel—19. The Use of Manganese—20. Spiegeleisen—21. Sulphur in Steel—22. Silicon in Steel—23. Tensile Strength of Steel—24. Mechanical Tests of Steel—25. Analysis of Steel. Section IV., USES OF STEEL: Chap. 26. Application of Steel to Railway Purposes—27. To Shipbuilding—28. To Bridge Building—29. To General Purposes—30. Guns and Armour Plates—31. Other Purposes.

The Maintenance of Macadamised Roads. By T. CODRINGTON, M.I.C.E., F.G.S., General Superintendent of County Roads for South Wales, 8vo, cloth, 6s.

Hydraulic Steam and Hand Power Lifting and Pressing Machinery. By FREDERICK COLYER, M. Inst. C.E., M. Inst. M.E. With 73 plates, 8vo, cloth, 18s.

Electric Lighting by Incandescence, and its application to interior illumination, a practical treatise, with 96 illustrations. By W. E. SAWYER. 8vo, cloth, 10s. 6d.

Girder Making and the Practice of Bridge Building in Wrought Iron, illustrated by Examples of Bridges, Piers, and Girder Work, etc., constructed at the Skerne Iron Works, Darlington, by EDWARD HUTCHINSON, M. Inst. M.E. With 35 plates, demy 8vo, cloth, 10s. 6d.

Spons' Dictionary of Engineering, Civil, Mechanical, Military, and Naval; with technical terms in French, German, Italian, and Spanish, 3100 pp., and nearly 8000 engravings, in super-royal 8vo, in 8 divisions, 5l. 8s. Complete in 3 vols., cloth, 5l. 5s. Bound in a superior manner, half-morocco, top edge gilt, 3 vols., 6l. 12s.

See page 15.

A Treatise on the Origin, Progress, Prevention, and Cure of Dry Rot in Timber; with Remarks on the Means of Preserving Wood from Destruction by Sea-Worms, Beetles, Ants, etc. By THOMAS ALLEN BRITTON, late Surveyor to the Metropolitan Board of Works, etc., etc. Plates, crown 8vo, cloth, 7s. 6d.

Metrical Tables. By G. L. MOLESWORTH, M.I.C.E.
32mo, cloth, 1s. 6d.

CONTENTS.

General—Linear Measures—Square Measures—Cubic Measures—Measures of Capacity—Weights—Combinations—Thermometers.

A Handbook of Electrical Testing. By H. R. KEMPE, Member of the Society of Telegraph Engineers. New edition, revised and enlarged, with Illustrations. Crown 8vo, cloth, 12s. 6d.

Electricity; its Theory, Sources, and Applications.
By JOHN T. SPRAGUE, Member of the Society of Telegraph Engineers.
With 91 woodcuts and 30 valuable Tables. Crown 8vo, cloth, 8s.

Electro-Telegraphy. By FREDERICK S. BEECHY, Telegraph Engineer, a Book for Beginners. Fcap. 8vo, sewn 6d.

Handrailing: by the Square Cut. By JOHN JONES, Staircase Builder. Fourth edition. With seven plates, 8vo, cloth, 3s. 6d.

Handrailing: by the Square Cut. By JOHN JONES, Staircase Builder. Part Second, with eight plates, 8vo, cloth, 3s. 6d.

The Gas Consumer's Handy Book. By WILLIAM RICHARDS, C.E. Illustrated. 18mo, sewed, 6d.

A Pocket-Book of Useful Formulæ and Memoranda for Civil and Mechanical Engineers. By GUILFORD L. MOLESWORTH, Mem. Inst. C.E., Consulting Engineer to the Government of India for State Railways. Twentieth edition, 32mo, roan, 6s.; or printed on India paper and bound in pocket-book form, in russia or morocco, 7s. 6d.

SYNOPSIS OF CONTENTS:

Surveying, Levelling, etc.—Strength and Weight of Materials—Earthwork, Brickwork, Masonry, Arches, etc.—Struts, Columns, Beams, and Trusses—Flooring, Roofing, and Roof Trusses—Girders, Bridges, etc.—Railways and Roads—Hydraulic Formulæ—Canals, Sewers, Waterworks, Docks—Irrigation and Breakwaters—Gas, Ventilation, and Warming—Heat, Light, Colour, and Sound—Gravity: Centres, Forces, and Powers—Millwork, Teeth of Wheels, Shafting, etc.—Workshop Recipes—Sundry Machinery—Animal Power—Steam and the Steam Engine—Water-power, Water-wheels, Turbines, etc.—Wind and Windmills—Steam Navigation, Ship Building, Tonnage, etc.—Gunnery, Projectiles, etc.—Weights, Measures, and Money—Trigonometry, Conic Sections, and Curves—Telegraphy—Mensuration—Tables of Areas and Circumference, and Arcs of Circles—Logarithms, Square and Cube Roots, Powers—Reciprocals, etc.—Useful Numbers—Differential and Integral Calculus—Algebraic Signs—Telegraphic Construction and Formulæ.

"Most of our readers are already acquainted with Molesworth's Pocket-book, and not a few, we imagine, are indebted to it for valuable information, or for refreshers of the memory. The book has been re-arranged, the supplemental formulæ and tables added since the first issue having now been incorporated with the body of the book in their proper positions, the whole making a handy size for the pocket. Every care has been taken to ensure correctness, both clerically and typographically, and the book is an indispensable *vade-mecum* for the mechanic and the professional man."—*English Mechanic*.

Spons' Tables and Memoranda for Engineers; selected and arranged by J. T. HURST, C.E., Author of 'Architectural Surveyors' Handbook,' 'Hurst's Tredgold's Carpentry,' etc. 64mo, roan, gilt edges, third edition, revised and improved, 1s. Or in cloth case, 1s. 6d.

This work is printed in a pearl type, and is so small, measuring only 2½ in. by 1½ in. by ½ in. thick, that it may be easily carried in the waistcoat pocket.

"It is certainly an extremely rare thing for a reviewer to be called upon to notice a volume measuring but 2½ in. by 1½ in., yet these dimensions faithfully represent the size of the handy little book before us. The volume—which contains 118 printed pages, besides a few blank pages for memoranda—is, in fact, a true pocket-book, adapted for being carried in the waistcoat pocket, and containing a far greater amount and variety of information than most people would imagine could be compressed into so small a space. . . . The little volume has been compiled with considerable care and judgment, and we can cordially recommend it to our readers as a useful little pocket companion."—*Engineering*.

Analysis, Technical Valuation, Purification and Use of Coal Gas. By the Rev. W. R. BOWDITCH, M.A. With wood engravings, 8vo, cloth, 12s. 6d.

Condensation of Gas—Purification of Gas—Light—Measuring—Place of Testing Gas—Test Candles—The Standard for Measuring Gas—light—Test Burners—Testing Gas for Sulphur—Testing Gas for Ammonia—Condensation by Bromine—Gravimetric Method of taking Specific Gravity of Gas—Carburetted or Naphthalizing Gas—Acetylene—Explosions of Gas—Gnawing of Gaspipes by Rats—Pressure as related to Public Lighting, etc.

A Practical Treatise on Natural and Artificial Concrete, its Varieties and Constructive Adaptations. By HENRY REID, Author of the 'Science and Art of the Manufacture of Portland Cement.' With numerous woodcuts and plates, 8vo, cloth, 15s.

The Gas Analyst's Manual. By F. W. HARTLEY, Assoc. Inst. C.E., etc. *With numerous illustrations.* Crown 8vo, cloth, 6s.

The French - Polisher's Manual. By a French-Polisher; containing Timber Staining, Washing, Matching, Improving, Painting, Imitations, Directions for Staining, Sizing, Embodying, Smoothing, Spirit Varnishing, French-Polishing, Directions for Repolishing. Third edition, royal 32mo, sewed, 6d.

Hops, their Cultivation, Commerce, and Uses in various Countries. By P. L. SIMMONDS. Crown 8vo, cloth, 4s. 6d.

A Practical Treatise on the Manufacture and Distribution of Coal Gas. By WILLIAM RICHARDS. Demy 4to, with numerous wood engravings and large plates, cloth, 28s.

SYNOPSIS OF CONTENTS :

Introduction—History of Gas Lighting—Chemistry of Gas Manufacture, by Lewis Thompson, Esq., M.R.C.S.—Coal, with Analyses, by J. Paterson, Lewis Thompson, and G. R. Hislop, Esqrs.—Retorts, Iron and Clay—Retort Setting—Hydraulic Main—Condensers—Exhausters—Washers and Scrubbers—Purifiers—Purification—History of Gas Holder—Tanks, Brick and Stone, Composite, Concrete, Cast-iron, Compound Annular Wrought-iron—Specifications—Gas Holders—Station Meter—Governor—Distribution—Mains—Gas Mathematics, or Formulae for the Distribution of Gas, by Lewis Thompson, Esq.—Services—Consumers' Meters—Regulators—Burners—Fittings—Photometer—Carburization of Gas—Air Gas and Water Gas—Composition of Coal Gas, by Lewis Thompson, Esq.—Analyses of Gas—Influence of Atmospheric Pressure and Temperature on Gas—Residual Products—Appendix—Description of Retort Settings, Buildings, etc., etc.

Practical Geometry and Engineering Drawing; a Course of Descriptive Geometry adapted to the Requirements of the Engineering Draughtsman, including the determination of cast shadows and Isometric Projection, each chapter being followed by numerous examples; to which are added rules for Shading Shade-lining, etc., together with practical instructions as to the Lining, Colouring, Printing, and general treatment of Engineering Drawings, with a chapter on drawing Instruments. By GEORGE S. CLARKE, Lieut. R.E., Instructor in Mechanical Drawing, Royal Indian Engineering College, Cooper's Hill. 20 plates, 4to, cloth, 15s.

The Elements of Graphic Statics. By Professor KARL VON OTT, translated from the German by G. S. CLARKE, Lieut. R.E., Instructor in Mechanical Drawing, Royal Indian Engineering College, Cooper's Hill. Crown 8vo, cloth, 5s.

See page 2.

A Practical Treatise on Heat, as applied to the Useful Arts; for the Use of Engineers, Architects, etc. By THOMAS BOX. *With 14 plates.* Third edition, crown 8vo, cloth, 12s. 6d.

The New Formula for Mean Velocity of Discharge of Rivers and Canals. By W. R. KUTTER, translated from articles in the 'Cultur-Ingenieur.' By LOWIS D'A. JACKSON, Assoc. Inst. C.E. 8vo, cloth, 12s. 6d.

Hydraulics of Great Rivers; being Observations and Surveys on the Largest Rivers of the World. By J. J. REVY. Imp. 4to, cloth, with eight large plates and charts, 2l. 2s.

Practical Hydraulics; a Series of Rules and Tables for the use of Engineers, etc., etc. By THOMAS BOX. Fifth edition, numerous plates, post 8vo, cloth, 5s.

A Practical Treatise on the Construction of Horizontal and Vertical Waterwheels, with 11 plates, specially designed for the use of operative mechanics. By WILLIAM CULLEN, Millwright and Engineer. Second edition, revised and enlarged, small 4to, cloth, 12s. 6d.

Link-Motion and Expansion Gear Practically Considered. By N. P. BURGH, Engineer. Illustrated with 90 plates and 229 wood engravings, small 4to, cloth, 30s.

The Mechanician and Constructor for Engineers, comprising Forging, Planing, Lining, Slotting, Shaping, Turning, Screw Cutting, etc. By CAMERON KNIGHT. Containing 96 plates, 1147 illustrations, and 397 pages of letterpress. Cheaper edition, cloth, 18s.

The Essential Elements of Practical Mechanics; based on the Principle of Work, designed for Engineering Students. By OLIVER BYRNE, formerly Professor of Mathematics, College for Civil Engineers. Third edition, illustrated by numerous wood engravings, post 8vo, cloth, 7s. 6d.

CONTENTS:

Chap. 1. How Work is Measured by a Unit, both with and without reference to a Unit of Time—Chap. 2. The Work of Living Agents, the Influence of Friction, and introduces one of the most beautiful Laws of Motion—Chap. 3. The principles expounded in the first and second chapters are applied to the Motion of Bodies—Chap. 4. The Transmission of Work by simple Machines—Chap. 5. Useful Propositions and Rules.

The Practical Millwright's and Engineer's Ready Reckoner; or Tables for finding the diameter and power of cog-wheels, diameter, weight, and power of shafts, diameter and strength of bolts, etc. By THOMAS DIXON. Fourth edition, 12mo, cloth, 3s.

Breweries and Malting: their Arrangement, Construction, Machinery, and Plant. By G. SCAMELL, F.R.S., B.A. Second edition, revised, enlarged, and partly rewritten. By F. COLYER, M.I.C.E., M.I.M.E., with 20 plates, 8vo, cloth, 18s.

A Practical Treatise on Mill-gearing, Wheels, Shafts, Riggers, etc.; for the use of Engineers. By THOMAS BOX. Crown 8vo, cloth, with 11 plates, second edition, 7s. 6d.

Mining Machinery: a Descriptive Treatise on the Machinery, Tools, and other Appliances used in Mining. By G. G. ANDRÉ, F.G.S., Assoc. Inst. C.E., Mem. of the Society of Engineers. Royal 4to, uniform with the Author's Treatise on Coal Mining, containing 182 plates, accurately drawn to scale, with descriptive text, in 2 vols., cloth, 3l. 12s.

CONTENTS:

Machinery for Prospecting, Excavating, Hauling, and Hoisting—Ventilation—Pumping—Treatment of Mineral Products, including Gold and Silver, Copper, Tin, and Lead, Iron, Coal, Sulphur, China Clay, Brick Earth, etc.

The Pattern Maker's Assistant; embracing Lathe Work, Branch Work, Core Work, Sweep Work, and Practical Gear Construction, the Preparation and Use of Tools, together with a large collection of Useful and Valuable Tables. By JOSHUA ROSE, M.E. With 250 illustrations. Crown 8vo, cloth, 10s. 6d.

The Science and Art of the Manufacture of Portland Cement, with observations on some of its constructive applications, with numerous illustrations. By HENRY REID, C.E., Author of 'A Practical Treatise on Concrete,' etc., etc. 8vo, cloth, 18s.

The Draughtsman's Handbook of Plan and Map Drawing; including instructions for the preparation of Engineering, Architectural, and Mechanical Drawings. With numerous illustrations in the text, and 33 plates (15 printed in colours). By G. G. ANDRÉ, F.G.S., Assoc. Inst. C.E. 4to, cloth, reduced to 9s.

CONTENTS:

The Drawing Office and its Furnishings—Geometrical Problems—Lines, Dots, and their Combinations—Colours, Shading, Lettering, Bordering, and North Points—Scales—Plotting—Civil Engineers' and Surveyors' Plans—Map Drawing—Mechanical and Architectural Drawing—Copying and Reducing Trigonometrical Formulæ, etc., etc.

The Railway Builder: a Handbook for Estimating the Probable Cost of American Railway Construction and Equipment. By WILLIAM J. NICOLLS, Civil Engineer. Illustrated, full bound, pocket-book form, 7s. 6d.

Rock Blasting: a Practical Treatise on the means employed in Blasting Rocks for Industrial Purposes. By G. G. ANDRÉ, F.G.S., Assoc. Inst. C.E. With 56 illustrations and 12 plates, 8vo, cloth, 10s. 6d.

Surcharged and different Forms of Retaining Walls. By J. S. TATE. Cutr, 8vo, sewed, 2s.

A Treatise on Ropemaking as practised in public and private Rope-yards, with a Description of the Manufacture, Rules, Tables of Weights, etc., adapted to the Trade, Shipping, Mining, Railways, Builders, etc. By R. CHAPMAN, formerly foreman to Messrs. Huddart and Co., Limehouse, and late Master Ropemaker to H.M. Dockyard, Deptford. Second edition, 12mo, cloth, 3s.

Sanitary Engineering; a Series of Lectures given before the School of Engineering, Chatham. Division I. Air.—Division II. Water.—Division III. The Dwelling.—Division IV. The Town and Village.—Division V. The Disposal of Sewage. Copiously illustrated. By J. BAILEY DENTON, C.E., F.G.S., Honorary Member of the Agricultural Societies of Norway, Sweden, and Hanover, and Author of the 'Farm Homesteads of England,' 'Village Sanitary Economy,' 'Storage of Water,' 'Sewage Farming,' etc. Royal 8vo, cloth, 25s.

Sanitary Engineering: a Guide to the Construction of Works of Sewerage and House Drainage, with Tables for facilitating the calculations of the Engineer. By BALDWIN LATHAM, C.E., M. Inst. C.E., F.G.S., F.M.S., Past-President of the Society of Engineers. Second edition, with numerous plates and woodcuts, 8vo, cloth, 17. 10s.

A Practical Treatise on Modern Screw-Propulsion. By N. P. BURGH, Engineer. Illustrated with 52 large plates and 103 woodcuts, 4to, half-morocco, 21. 2s.

Screw Cutting Tables for Engineers and Machinists, giving the values of the different trains of Wheels required to produce Screws of any pitch, calculated by Lord Lindsay, M.P., F.R.S., F.R.A.S., etc. Royal 8vo, cloth, oblong, 2s.

Screw Cutting Tables, for the use of Mechanical Engineers, showing the proper arrangement of Wheels for cutting the Threads of Screws of any required pitch, with a Table for making the Universal Gas-pipe Threads and Taps. By W. A. MARTIN, Engineer. Second edition, royal 8vo, oblong, cloth, 1s.

A Treatise on a Practical Method of Designing Slide-Valve Gears by Simple Geometrical Construction, based upon the principles enunciated in Euclid's Elements, and comprising the various forms of Plain Slide-Valve and Expansion Gearing; together with Stephenson's, Gooch's, and Allan's Link-Motions, as applied either to reversing or to variable expansion combinations. By EDWARD J. COWLING WELCH, Memb. Inst. Mechanical Engineers. Crown 8vo, cloth, 6s.

Cleaning and Scouring: a Manual for Dyers, Laundresses, and for Domestic Use. By S. CHRISTOPHER. 18mo, sewed, 6d.

Treatise on Valve-Gears, with special consideration of the Link-Motions of Locomotive Engines. By Dr. GUSTAV ZEUNER. Third edition, revised and enlarged, translated from the German, with the special permission of the author, by MORITZ MÜLLER. *Plates*, 8vo, cloth, 12s. 6d.

A Pocket-Book for Boiler Makers and Steam Users, comprising a variety of useful information for Employer and Workman, Government Inspectors, Board of Trade Surveyors, Engineers in charge of Works and Slips, Foremen of Manufactories, and the general Steam-using Public. By MAURICE JOHN SEXTON. Royal 32mo, roan, gilt edges, 5s.

The Strains upon Bridge Girders and Roof Trusses, including the Warren, Lattice, Trellis, Bowstring, and other Forms of Girders, the Curved Roof, and Simple and Compound Trusses. By THOS. CARGILL, C.E.B.A.T., C.D., Assoc. Inst. C.E., Member of the Society of Engineers, with 64 illustrations, drawn and worked out to scale, 8vo, cloth, 12s. 6d.

A Practical Treatise on the Steam Engine, containing Plans and Arrangements of Details for Fixed Steam Engines, with Essays on the Principles involved in Design and Construction. By ARTHUR RIGG, Engineer, Member of the Society of Engineers and of the Royal Institution of Great Britain. Demy 4to, copiously illustrated with woodcuts and 96 plates, in one Volume, half-bound morocco, 2l. 2s.; or cheaper edition, cloth, 25s.

This work is not, in any sense, an elementary treatise, or history of the steam engine, but is intended to describe examples of Fixed Steam Engines without entering into the wide domain of locomotive or marine practice. To this end illustrations will be given of the most recent arrangements of Horizontal, Vertical, Beam, Pumping, Winding, Portable, Semi-portable, Corliss, Allen, Compound, and other similar Engines, by the most eminent Firms in Great Britain and America. The laws relating to the action and precautions to be observed in the construction of the various details, such as Cylinders, Pistons, Piston-rods, Connecting-rods, Cross-heads, Motion-blocks, Eccentrics, Simple, Expansion, Balanced, and Equilibrium Slide-valves, and Valve-gearing will be minutely dealt with. In this connection will be found articles upon the Velocity of Reciprocating Parts and the Mode of Applying the Indicator, Heat and Expansion of Steam Governors, and the like. It is the writer's desire to draw illustrations from every possible source, and give only those rules that present practice deems correct.

BARLOW'S *Tables of Squares, Cubes, Square Roots, Cube Roots, Reciprocals of all Integer Numbers up to 10,000*. Post 8vo, cloth, 6s.

CAMUS (M.) *Treatise on the Teeth of Wheels*, demonstrating the best forms which can be given to them for the purposes of Machinery, such as Mill-work and Clock-work, and the art of finding their numbers, translated from the French, third edition, carefully revised and enlarged, with details of the present practice of Millwrights, Engine Makers, and other Machinists. By ISAAC HAWKINS. *Illustrated by 18 plates*, 8vo, cloth, 5s.

A Practical Treatise on the Science of Land and Engineering Surveying, Levelling, Estimating Quantities, etc., with a general description of the several Instruments required for Surveying, Levelling, Plotting, etc. By H. S. MERRETT. 41 fine plates with Illustrations and Tables, royal 8vo, cloth, third edition, 12s. 6d.

PRINCIPAL CONTENTS :

Part 1. Introduction and the Principles of Geometry. Part 2. Land Surveying; comprising General Observations—The Chain—Offsets Surveying by the Chain only—Surveying Hilly Ground—To Survey an Estate or Parish by the Chain only—Surveying with the Theodolite—Mining and Town Surveying—Railroad Surveying—Mapping—Division and Laying out of Land—Observations on Enclosures—Plane Trigonometry. Part 3. Levelling—Simple and Compound Levelling—The Level Book—Parliamentary Plan and Section—Levelling with a Theodolite—Gradients—Wooden Curves—To Lay out a Railway Curve—Setting out Widths. Part 4. Calculating Quantities generally for Estimates—Cuttings and Embankments—Tunnels—Brickwork—Ironwork—Timber Measuring. Part 5. Description and Use of Instruments in Surveying and Plotting—The Improved Dumpy Level—Troughton's Level—The Prismatic Compass—Proportional Compass—Box Sextant—Vernier—Pantagraph—Merrett's Improved Quadrant—Improved Computation Scale—The Diagonal Scale—Straight Edge and Sector. Part 6. Logarithms of Numbers—Logarithmic Sines and Co-Sines, Tangents and Co-Tangents—Natural Sines and Co-Sines—Tables for Earthwork, for Setting out Curves, and for various Calculations, etc., etc., etc.

Saws: the History, Development, Action, Classification, and Comparison of Saws of all kinds. By ROBERT GRIMSHAW. With 220 illustrations, 4to cloth, 12s. 6d.

A Guide for the Electric Testing of Telegraph Cables. By Capt. V. HOSKIER, Royal Danish Engineers. With illustrations. Second edition, crown 8vo, cloth, 4s. 6d.

Laying and Repairing Electric Telegraph Cables. By Capt. V. HOSKIER, Royal Danish Engineers. Crown 8vo, cloth, 3s. 6d.

A Pocket-Book of Practical Rules for the Proportions of Modern Engines and Boilers for Land and Marine purposes. By N. P. BURGH. Seventh edition, royal 32mo, roan, 4s. 6d.

Details of High-Pressure Engine, Beam Engine, Condensing, Marine Screw Engines, Oscillating Engines, Valves, etc., Land and Marine Boilers, Proportions of Engines produced by the Rules, Proportions of Boilers, etc.

Table of Logarithms of the Natural Numbers, from 1 to 108,000. By CHARLES BABBAGE, Esq., M.A. Stereotyped edition, royal 8vo, cloth, 7s. 6d.

To ensure the correctness of these Tables of Logarithms, they were compared with Callett's, Vega's, Hutton's, Briggs', Gardiner's, and Taylor's Tables of Logarithms, and carefully read by nine different readers; and further, to remove any possibility of an error remaining, the stereotyped sheets were hung up in the Hall at Cambridge University, and a reward offered to anyone who could find an inaccuracy. So correct are these Tables, that since their first issue in 1827 no error has been discovered.

The Steam Engine considered as a Heat Engine: a
Treatise on the Theory of the Steam Engine, illustrated by Diagrams,
Tables, and Examples from Practice. By JAS. H. COTTERILL, M.A.,
Professor of Applied Mechanics in the Royal Naval College. 8vo, cloth,
12s. 6d.

The Practice of Hand Turning in Wood, Ivory, Shell,
etc., with Instructions for Turning such Work in Metal as may be required
in the Practice of Turning in Wood, Ivory, etc., also an Appendix on
Ornamental Turning. (A book for beginners). By FRANCIS CAMPIN.
Second edition, with wood engravings, crown 8vo, cloth, 6s.

CONTENTS :

On Lathes—Turning Tools—Turning Wood—Drilling—Screw Cutting—Miscellaneous
Apparatus and Processes—Turning Particular Forms—Staining—Polishing—Spinning Metals
—Materials—Ornamental Turning, etc.

Health and Comfort in House Building, or Ventila-
tion with Warm Air by Self-Acting Suction Power, with Review of the
mode of Calculating the Draught in Hot-Air Flues, and with some actual
Experiments. By J. DRYSDALE, M.D., and J. W. HAYWARD, M.D.
Second edition, with Supplement, demy 8vo, with plates, cloth, 7s. 6d.

Treatise on Watchwork, Past and Present. By the
Rev. H. L. NELTHROPP, M.A., F.S.A. Numerous illustrations, crown
8vo, cloth, 6s. 6d.

CONTENTS :

Definitions of Words and Terms used in Watchwork—Tools—Time—Historical Sum-
mary—On Calculations of the Numbers for Wheels and Pinions; their Proportional Sizes,
Trains, etc.—Of Dial Wheels, or Motion Work—Length of Time of Going without Winding
up—The Verge—The Horizontal—The Duplex—The Lever—The Chronometer—Repeating
Watches—Keyless Watches—The Pendulum, or Spiral Spring—Compensation—Jewelling of
Pivot Holes—Clerkenwell—Fallacies of the Trade—Incapacity of Workmen—How to Choose
and Use a Watch, etc.

Spons' Engineers' and Contractors' Illustrated Book
of Prices of Machines, Tools, Ironwork, and Contractors' Material;
and Engineers' Directory. Third edition, 4to, cloth, 6s.

The Chemistry of Sulphuric Acid Manufacture. By
HENRY ARTHUR SMITH. Cuts, crown 8vo, cloth, 4s. 6d.

CONTENTS :

Ground Plan of Kilns for Burning Sulphur Ores—Section of Pyrites Furnace—On the
Presence of Arsenic—Methods for Removal of Arsenic—An Experimental Examination of the
Circumstances which determine the Action of the Gases in the Lead Chamber—On the Dis-
tribution of Gases in the Lead Chamber—On the Temperature at which Nitric Acid acts upon
Sulphurous Acid—On the Distribution of Heat in the Lead Chamber—An Inquiry into the
Best Form of Leaden Chamber, etc.

JUST PUBLISHED.

In 18 Monthly Parts, each Part containing 64 pp., with *numerous illustrations*, super-royal, 8vo, price 2s. ; or in 3 Divisions, cloth, price 13s. 6d. each ; or 1 vol., cloth, 2l.

A SUPPLEMENT

TO

SPONS' DICTIONARY OF ENGINEERING,

Civil, Mechanical, Military, and Naval.

EDITED BY ERNEST SPON, MEMB. SOC. ENGINEERS.

THE success which has attended the publication of 'SPONS' DICTIONARY OF ENGINEERING' has encouraged the Publishers to use every effort tending to keep the work up to the standard of existing professional knowledge. As the Book has now been some years before the public without addition or revision, there are many subjects of importance which, of necessity, are either not included in its pages, or have been treated somewhat less fully than their present importance demands. With the object, therefore, of remedying these omissions, this Supplement is now being issued. Each subject in it is treated in a thoroughly comprehensive way ; but, of course, without repeating the information already included in the body of the work.

The new matter comprises articles upon

| | | |
|---|---|--|
| Abacus, Counters, Speed Indicators, and Slide Rule. | Coal Mining. | Lighthouses, Buoys, and Beacons. |
| Agricultural Implements and Machinery. | Coal Cutting Machines. | Machine Tools. |
| Air Compressors. | Coke Ovens. Copper. | Materials of Construction. |
| Animal Charcoal Machinery. | Docks. Drainage. | Meters. |
| Antimony. | Dredging Machinery. | Ores, Machinery and Processes employed to Dress. |
| Axles and Axle-boxes. | Dynamo - Electric and Magneto-Electric Machines. | Piers. |
| Barn Machinery. | Dynamometers. | Pile Driving. |
| Belts and Belting. | Electrical Engineering, Telegraphy, Electric Lighting and its practical details, Telephones | Pneumatic Transmission. |
| Blasting. Boilers. | Engines, Varieties of. | Pumps. |
| Brakes. | Explosives. Fans. | Pyrometers. |
| Brick Machinery. | Founding, Moulding and the practical work of the Foundry. | Road Locomotives. |
| Bridges. | Gas, Manufacture of. | Rock Drills. |
| Cages for Mines. | Hammers, Steam and other Power. | Rolling Stock. |
| Calculus, Differential and Integral. | Heat. Horse Power. | Sanitary Engineering. |
| Canals. | Hydraulics. | Shafting. |
| Carpentry. | Hydro-geology. | Steam Engines. |
| Cast Iron. | Indicators. Iron. | Steel. |
| Cement, Concrete, Limes, and Mortar. | Lifts, Hoists, and Elevators. | Steam Navy. |
| Chimney Shafts. | | Stone Machinery. |
| Chimney Washing. | | Telegraphy. |
| | | Well Sinking. |
| | | Woodworking Machinery. |

Now in Course of Publication.

To be completed in about 30 Monthly Parts, each Part containing 64 pp., with *numerous illustrations*, super-royal 8vo, price 2s. ; or in 5 Divisions, cloth, price 13s. 6d. each.

DIVISIONS I., II., III., & IV., NOW READY.

SPONS' ENCYCLOPÆDIA

OF THE

INDUSTRIAL ARTS, MANUFACTURES, AND COMMERCIAL PRODUCTS.

Among the more important of the subjects treated of, are the following :—

| | | |
|----------------------|---------------------|-------------------------|
| Acids. | Food Preservation. | Paper. |
| Alcohol. | Fruit. | Paraffin. |
| Alcoholic Liquors. | Fur. | Pearl and Coral. |
| Alkalies. | Gas, Coal. | Perfumes. |
| Alloys. | Gems. | Photography. |
| Alum. | Glass. | Pigments. |
| Asphalt. | Graphite. | Pottery. |
| Assaying. | Hair. | Printing and Engraving. |
| Beverages. | Hair Manufactures. | Rags. |
| Blackening. | Hats | Resinous and Gummy |
| Blacks. | Honey. | Substances. |
| Bleaching Powder. | Hops. | Rope. |
| Bleaching. | Horn. | Salt. |
| Candles. | Ice. | Silk. |
| Carbon Bisulphide. | Indiarubber | Silk Manufactures. |
| Celluloid. | Manufac- tures. | Skins. |
| Cements. | Ink. | Small Goods. |
| Clay. | Ivory. | Soap. |
| Coal-tar Products. | Jute Manufactures. | Spices. |
| Cocoa. | Knitted Fabrics — | Sponge. |
| Coffee. | Hoisery. | Starch. |
| Cork. | Lace. | Sugar. |
| Cotton Manufactures. | Leather. | Sulphur. |
| Drugs. | Linen Manufactures. | Tannin. |
| Dyeing and Calico | Manures. | Tea. |
| Printing. | Matches. | Timber. |
| Dyestuffs. | Mordants. | Varnish. |
| Electro-Metallurgy. | Narcotics. | Vinegar. |
| Explosives. | Nuts. | Wax. |
| Feathers. | Oils and Fatty Sub- | Wool. |
| Fibrous Substances. | stances. | Woollen Manufactures. |
| Floor-cloth. | Paint. | |

London: E. & F. N. SPON, 16, Charing Cross.

New York: 446, Broome Street.

